

## Schedules

## Schedule-A

(See Clauses 2.1 and 8.1)

### Site of the Project

#### 1 The Site

- (i) Site of the Two-Lane with paved shoulder Project Highway shall include the land, buildings, structures and road works as described in Annex-I of this Schedule-A.
- (ii) The dates of handing over the Right of Way to the Contractor are specified in Annex-II of this Schedule-A.
- (iii) An inventory of the Site including the land, buildings, structures, road works, trees and any other immovable property on, or attached to, the Site shall be prepared jointly by the Authority Representative and the Contractor, and such inventory shall form part of the memorandum referred to in Clause 8.2 (i) of this Agreement.
- (iv) The alignment plans of the Project Highway are specified in Annex-III. In the case of sections where no modification in the existing alignment of the Project Highway is contemplated, the alignment plan has not been provided. Alignment plans have only been given for sections where the existing alignment is proposed to be upgraded. The proposed profile of the Project Highways shall be followed by the contractor with minimum FRL as indicated in the alignment plan. The Contractor, however, improve/upgrade the Road Profile as indicated in Annex-III based on site/design requirement.
- (v) The status of the environment clearances obtained or awaited is given in Annex-IV.

**Annex – I**  
**(Schedule-A)**  
**Site**

1. Site

The Site of the [Two lane] Project Highway comprises the section of National Highway 44A commencing from km 46.597 to km 66.845 i.e. the Kanchanpur - Vaghmun section in the State of Tripura. The land, carriageway and structures comprising the Site are described below.

2. Land

The Site of the Project Highway comprises the land (sum total of land already in possession & land to be possessed) as described below:

S.No.	Chainage (km)		Right of way (m)	Remarks
	From Ch	To Ch		
1	46597	50230	30	
2	50230	51230	45	
3	51230	55930	30	
4	55930	63520	45	
5	63520	66845	30	

3. Carriageway

The present carriageway of the Project Highway is Single Lane. The type of the existing pavement is flexible.

4. Major Bridges

The Site includes the following Major Bridges:

S.No.	Chainage (km)	Type of Structure			No. of Spans with span length (m)	Width (m)
		Foundation	Sub-structure	Superstructure		
NIL						

5. Road over-bridges (ROB)/ Road under-bridges (RUB)

The Site includes the following ROB (road over railway line)/RUB (road under railway line):

S.No.	Chainage (km)	Type of Structure		No. of Spans with span length (m)	Width (m)	ROB/ RUB
		Foundation	Superstructure			
NIL						

6. Grade separators

The Site includes the following grade separators:

S.No.	Chainage (km)	Type of Structure		No. of Spans with span length (m)	Width (m)
		Foundation	Superstructure		
NIL					

7. Minor bridges

The Site includes the following minor bridges:

S.No.	Chainage (km)	Type of Structure			No. of Spans with span length (m)	Width (m)
		Foundation	Sub-structure	Superstructure		
NIL						

8. Railway level crossings

The Site includes the following railway level crossings:

S. No.	Location (km)	Remark
NIL		

9. Underpasses (vehicular, non vehicular)

The Site includes the following underpasses:

S. No.	Chainage (km)	Type of Structure	No. of Spans with span length (m)	Width (m)
NIL				

10. Culverts

The Site has the following culverts:

a) Hume Pipe Culvert: - There are 28 Nos. existing HPC, the details are as follows –

S. No.	Chainage	Span Arrangement (m)	Total Width (m)
1	96+195	1X.090	12.00
2	96+515	1X.090	12.00
3	97+000	2X0.90	7.50
4	97+110	1X0.90	7.00
5	97+335	1X.090	12.00
6	97+485	1X0.90	12.00
7	98+840	1X0.90	9.00
8	99+550	1X0.90	9.10
9	100+060	1X0.90	8.50
10	100+965	1X0.90	9.10
11	101+085	1X0.90	6.40
12	102+735	1X0.90	8.10
13	103+030	1X0.90	8.10
14	104+240	1X0.90	8.00
15	104+340	1X0.90	8.10
16	104+525	1X0.90	12.00
17	104+890	1X0.90	6.80
18	104+945	1X0.90	6.80
19	105+620	1X0.90	6.80
20	105+850	1X0.90	6.80
21	106+000	1X0.90	6.80
22	106+075	1X0.90	6.80
23	108+615	1X0.90	8.50
24	108+800	1X0.90	7.80
25	109+120	1X0.90	7.60
26	109+325	1X0.90	7.50

S. No.	Chainage	Span Arrangement (m)	Total Width (m)
27	109+380	1X0.90	9.00
28	109+535	1X0.90	7.50

**b) Slab/Arch/Box Culvert:** - There are 08 nos existing Slab, details are as follows:-

S. No.	Chainage	Type of Structures (Slab / Arch)	Span arrangement (m)	Total Width(m)
1	87+235	RCC SLAB	1X4.50	12.20
2	87+380	RCC SLAB	1X1.55	12.00
3	92+175	RCC SLAB	1X1.55	12.00
4	92+975	RCC SLAB	1X1.50	12.00
5	93+740	RCC SLAB	1X1.55	12.10
6	97+705	RCC SLAB	1X1.00	7.10
7	97+745	RCC SLAB	1X1.50	12.10
8	102+870	RCC SLAB	1X2.00	10.10

#### 11. Bus bays

The details of bus bays on the Site are as follows:

S. No.	Chainage (km)	Length (m)	Left Hand Side	Right Hand Side
NIL				

#### 12. Truck Lay byes

The details of truck lay byes are as follows:

S. No.	Chainage (km)	Length (m)	Left Hand Side	Right Hand Side
NIL				

#### 13. Road side drains

The details of the roadside drains are as follows:

S. No.	Location	Type
NIL		

#### 14. Major junctions

The details of major junctions are as follows:

S. No.	Location (km)	At grade	Separated	Category of Cross Road			
				NH	SH	MDR	Others
NIL							

(NH: National Highway, SH: State Highway, MDR: Major District Road)

15. Minor junctions

The details of the minor junctions are as follows:

S. No.	Location	Type	
	km	T-Junction	Cross road
1	87+075	T-Type	Village Road
2	87+370	T-Type	Village Road
3	87+425	T-Type	Village Road
4	87+505	T-Type	Village Road
5	88+075	Y-Type	Village Road
6	88+235	T-Type	Village Road
7	88+995	T-Type	Village Road
8	104+835	T-Type	Village Road
9	106+400	Y-Type	Village Road
10	109+650	Y-Type	Village Road

16. Bypasses

The details of the existing road sections proposed to be bypassed are as follows:

S. No.	Name of bypass (town)	Chainage (km) From km to km	Length (in km)
NIL			

17 Other structures] - NIL

[Provide details of other structures, if any.]

## Annex – II

(As per Clause 8.3 (i))

(Schedule-A)

### Dates for providing Right of Way of Construction Zone

The dates on which the Authority shall provide Right of Way of Construction Zone to the Contractor on different stretches of the Site are stated below:

Sl. No	From km to km	Length (km)	Width (m)	Date of providing ROW*
1	2	3	4	5
(i) Full Right of Way (full width) (a) Stretch (b) Stretch (c) Stretch				ROW will be provided before appointed date
(ii) Part Right of Way (part width) (a) Stretch (b) Stretch (c) Stretch				
(iii) Balance Right of Way (width) a) Stretch b) Stretch c) Stretch				

\* The dates specified herein shall in no case be beyond 150 (one hundred and fifty) days after the Appointed Date.

## Annex - III

### (Schedule-A)

#### Alignment Plans

The existing alignment of the Project Highway shall be modified in the following sections as per the alignment plan given in drawing volume.

- (i) The alignment of the Project Highway is enclosed in alignment plan. Finished road level indicated in the alignment plan shall be followed by the contractor as minimum FRL. In any case, the finished road level of the project highway shall not be less than those indicated in the alignment plan. The contractor shall, however, improve/upgrade the Road profile as indicated in Annex-III based on site/design requirement.
- (ii) Traffic Signage plan of the Project Highway showing numbers & location of traffic signs is enclosed. The contractor shall, however, improve/upgrade upon the traffic signage plan as indicated in Annex-III based on site/design requirement as per IRC:SP: 99 & IRC: 67.



## Annex – IV

(Schedule-A)

### Environment Clearances

The following environment clearances have been obtained:

- Environmental Clearance is not required as per new Notification of MoEF dated 22/08/2013.

## **Schedule - B**

(See Clause 2.1)

### **Development of the Project Highway**

#### **1. Development of the Project Highway**

Development of the Project Highway shall include design and construction of the Project Highway as described in this Schedule-B and in Schedule-C.

#### **2. Rehabilitation and augmentation**

Rehabilitation and augmentation shall include Two-Laning with paved shoulder of the Project Highway as described in Annex-I of this Schedule-B and in Schedule-C.

#### **3. Specifications and Standards**

The Project Highway shall be designed and constructed in conformity with the Specifications and Standards specified in Annex-I of Schedule-D.

## Annex - I (Schedule-B)

### Description of Two laning

[Note: Description of the Project Highway shall be given by the Authority in detail together with explanatory drawings (where necessary) to explain the Authority's requirements precisely in order to avoid subsequent changes in the Scope of the Project. The particulars that must be specified in this Schedule-B are listed below as per the requirements of the Manual of Specifications and Standards for [Two Laning of Highways (IRC:SP:73)], referred to as the Manual. If any standards, specifications or details are not given in the Manual, the minimum design/construction requirements shall be specified in this Schedule. In addition to these particulars, all other essential project specific details, as required, should be provided in order to define the Scope of the Project clearly and precisely.]

#### 1. Widening of the Existing Highway

- (i) The Project Highway shall follow the existing alignment unless otherwise specified by the Authority and shown in the alignment plans specified in Annex-III of Schedule-A. Geometric deficiencies, if any, in the existing horizontal and vertical profiles shall be corrected as per the prescribed standards for [plain/rolling] terrain to the extent land is available.

##### (ii) Width of Carriageway

(A) Two-Lane with paved shoulder in Plain/Rolling Terrain in open Country area: - The Carriageway shall be 7.0 m. wide with 2.50 m. paved shoulder both side and 1.5 m earthen shoulder both side shall be provided. The width of carriage way shall be specified in following table:

Sl. No.	Built-up-Stretch (Township)	Location (km to km)		Width (m)	Typical cross section (Ref. to Manual)
1.	-	46.597	47.520	7+2.5x2+1.5x2=15 m	Fig. 2.1

(B) Two-Lane with paved shoulder in Hilly Terrain with Hill side Drain on Both sides and breast wall on one side in open Country area (Box cut): - The Carriageway shall be 7.0 m wide with 2.0 m. paved shoulder both side shall be provided. The width of carriage way shall be specified in following table:

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	54.300	54.720	0.420	7+2.0x2=11 m	Fig 2.11a (New)
2.	55.020	55.120	0.100	7+2.0x2=11 m	Fig 2.11a (New)
3.	55.520	55.670	0.150	7+2.0x2=11 m	Fig 2.11a (New)
4.	55.920	57.020	1.100	7+2.0x2=11 m	Fig 2.11a (New)
5.	57.320	57.620	0.300	7+2.0x2=11 m	Fig 2.11a (New)
6.	57.720	57.970	0.250	7+2.0x2=11 m	Fig 2.11a (New)
7.	58.070	58.120	0.050	7+2.0x2=11 m	Fig 2.11a (New)

8.	58.220	58.420	0.200	7+2.0x2=11 m	Fig 2.11a (New)
9.	58.720	59.270	0.550	7+2.0x2=11 m	Fig 2.11a (New)
10.	59.820	60.270	0.450	7+2.0x2=11 m	Fig 2.11a (New)
11.	60.470	60.720	0.250	7+2.0x2=11 m	Fig 2.11a (New)
12.	60.870	61.020	0.150	7+2.0x2=11 m	Fig 2.11a (New)
13.	61.320	61.420	0.100	7+2.0x2=11 m	Fig 2.11a (New)
14.	62.070	62.970	0.900	7+2.0x2=11 m	Fig 2.11a (New)
15.	63.070	63.270	0.200	7+2.0x2=11 m	Fig 2.11a (New)
16.	63.470	63.570	0.100	7+2.0x2=11 m	Fig 2.11a (New)
17.	63.670	64.070	0.400	7+2.0x2=11 m	Fig 2.11a (New)
18.	64.470	64.820	0.350	7+2.0x2=11 m	Fig 2.11a (New)
19.	65.220	65.420	0.200	7+2.0x2=11 m	Fig 2.11a (New)
20.	65.570	65.720	0.150	7+2.0x2=11 m	Fig 2.11a (New)
21.	66.020	66.470	0.450	7+2.0x2=11 m	Fig 2.11a (New)
Total			6.820		

- (C) Two-Lane with with paved shoulder in Hilly Terrain with Hill side Drain and breast wall on both sides in open Country area (Box cut): - The Carriageway shall be 7.0 m wide with 2.00 m. paved shoulder both side shall be provided. The width of carriage way shall be specified in following table:

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	55.220	55.320	0.100	7+2x2=11 m	Fig. 2.11b (New)
Total			0.100		

- (D) Two-Lane with with paved shoulder in Hilly Terrain with Hill side Drain on Both sides in open Country area (Box cut): - The Carriageway shall be 7.0 m wide with 2.00 m. paved shoulder both side shall be provided. The width of carriage way shall be specified in following table:

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	50.320	50.420	0.100	7+2x2=11 m	Fig 2.11 (New)
Total			0.100		

- (E) Two Lane Road with Paved shoulders in Hilly Terrain with Trapezoidal drain on hill side and retaining wall on valley side :- The Carriageway shall be 7.0 m wide with 1.5 m paved shoulder both side and 1.0 m earthen shoulder valley side shall be provided. The width of carriageway specified following table-

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	48.120	49.220	1.100	7+1.5x2+1x1=11 m	Fig 2.8
2.	52.320	52.420	0.100	7+1.5x2+1x1=11 m	Fig 2.8
Total			1.200		

- (F) Two Lane Road with Paved shoulders in Hilly Terrain with Hill side drain :- The Carriageway shall be 7.0 m wide with 1.5 m paved shoulder Valley side and 1.0 m

earthen shoulder Both side shall be provided. The width of carriageway specified following table-

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	47.520	48.120	0.600	7+1.5x2+1x1=11 m	Fig 2.9
2.	49.220	50.320	1.100	7+1.5x2+1x1=11 m	Fig 2.9
3.	50.420	52.320	1.900	7+1.5x2+1x1=11 m	Fig 2.9
4.	52.420	54.300	1.880	7+1.5x2+1x1=11 m	Fig 2.9
5.	63.270	63.470	0.200	7+1.5x2+1x1=11 m	Fig 2.9
6.	63.570	63.670	0.100	7+1.5x2+1x1=11 m	Fig 2.9
7.	64.070	64.470	0.400	7+1.5x2+1x1=11 m	Fig 2.9
8.	64.820	65.220	0.400	7+1.5x2+1x1=11 m	Fig 2.9
9.	65.420	65.570	0.150	7+1.5x2+1x1=11 m	Fig 2.9
10.	65.720	66.020	0.300	7+1.5x2+1x1=11 m	Fig 2.9
11.	66.470	66.845	0.375	7+1.5x2+1x1=11 m	Fig 2.9
Total			7.405		

(G) Two Lane Road with Paved shoulders in Hilly Terrain with Hill side drain and breast wall: - The Carriageway shall be 7.0 m wide with 1.5 m paved shoulder both side and 1.0 m earthen shoulder Valley side shall be provided. The width of carriageway specified following table-

Sl. No.	Location (km to km)		Length	Width (m)	Typical cross section (Ref. to Manual)
1.	54.720	55.020	0.300	7+1.5x2+1x1=11 m	Fig 2.9a (New)
2.	55.120	55.220	0.100	7+1.5x2+1x1=11 m	Fig 2.9a (New)
3.	55.320	55.520	0.200	7+1.5x2+1x1=11 m	Fig 2.9a (New)
4.	55.670	55.920	0.250	7+1.5x2+1x1=11 m	Fig 2.9a (New)
5.	57.020	57.320	0.300	7+1.5x2+1x1=11 m	Fig 2.9a (New)
6.	57.620	57.720	0.100	7+1.5x2+1x1=11 m	Fig 2.9a (New)
7.	57.970	58.070	0.100	7+1.5x2+1x1=11 m	Fig 2.9a (New)
8.	58.120	58.220	0.100	7+1.5x2+1x1=11 m	Fig 2.9a (New)
9.	58.420	58.720	0.300	7+1.5x2+1x1=11 m	Fig 2.9a (New)
10.	59.270	59.820	0.550	7+1.5x2+1x1=11 m	Fig 2.9a (New)
11.	60.270	60.470	0.200	7+1.5x2+1x1=11 m	Fig 2.9a (New)
12.	60.720	60.870	0.150	7+1.5x2+1x1=11 m	Fig 2.9a (New)
13.	61.020	61.320	0.300	7+1.5x2+1x1=11 m	Fig 2.9a (New)
14.	61.420	62.070	0.650	7+1.5x2+1x1=11 m	Fig 2.9a (New)
15.	62.970	63.070	0.100	7+1.5x2+1x1=11 m	Fig 2.9a (New)
Total			3.700		

(H) Except as otherwise provided in this Agreement, the width of the paved carriageway and cross-sectional features shall conform to paragraph 1.1 above.

## 2. Geometric Design and General Features

### (i) General

Geometric design and general features of the Project Highway shall be in accordance with Section 2 of the Manual.

### (ii) Design speed

The design speed shall be the minimum design speed of 80-100 km per hr for plain/ rolling terrain and 40-65 km per hr for hilly terrain.

### (iii) Improvement of the existing road geometrics

In the following sections, where improvement of the existing road geometrics to the prescribed standards is not possible, the existing road geometrics shall be improved to the extent possible within the given right of way and proper road signs and safety measures shall be provided:

Sl. No.	Stretch		Type of Deficiency	Remarks
	From	To		
1.	47164	47279	Radius-200	P/R terrain (builtup)
2.	47281	47417	Radius-200	P/R terrain (builtup)
3.	47723	47839	Radius-90	P/R terrain (builtup)
4.	47858	47925	Radius-155	P/R terrain (builtup)
5.	48150	48230	Radius-45	Hilly Terrain
6.	48401	48505	Radius-60	Hilly Terrain
7.	48806	48922	Radius-50	Hilly Terrain
8.	48951	49124	Radius-50	Hilly Terrain
9.	49125	49193	Radius-50	Hilly Terrain
10.	50067	50164	Radius-60	Hilly Terrain
11.	50802	50993	Radius-60	Hilly Terrain
12.	51033	51117	Radius-45	Hilly Terrain
13.	51497	51643	Radius-45	Hilly Terrain
14.	52140	52234	Radius-60	Hilly Terrain
15.	52277	52471	Radius-60	Hilly Terrain
16.	53069	53230	Radius-45	Hilly Terrain
17.	53866	54040	Radius-60	Hilly Terrain
18.	55145	55219	Radius-60	Hilly Terrain
19.	55219	55352	Radius-60	Hilly Terrain
20.	55358	55496	Radius-50	Hilly Terrain
21.	56398	56567	Radius-60	Hilly Terrain
22.	56583	56667	Radius-60	Hilly Terrain
23.	56698	56761	Radius-60	Hilly Terrain
24.	56774	56825	Radius-60	Hilly Terrain
25.	56877	56980	Radius-30	Hilly Terrain
26.	57259	57379	Radius-45	Hilly Terrain
27.	57533	57637	Radius-60	Hilly Terrain
28.	57645	57747	Radius-60	Hilly Terrain
29.	57921	58023	Radius-45	Hilly Terrain
30.	58044	58140	Radius-30	Hilly Terrain

31.	59713	59832	Radius-60	Hilly Terrain
32.	59930	60098	Radius-50	Hilly Terrain
33.	60591	60654	Radius-60	Hilly Terrain
34.	60973	60809	Radius-60	Hilly Terrain
35.	61266	61328	Radius-60	Hilly Terrain
36.	61330	61433	Radius-45	Hilly Terrain
37.	61463	61549	Radius-60	Hilly Terrain
38.	61592	61724	Radius-40	Hilly Terrain
39.	61781	61849	Radius-60	Hilly Terrain
40.	63189	63311	Radius-60	Hilly Terrain
41.	63318	63430	Radius-60	Hilly Terrain
42.	63454	63539	Radius-60	Hilly Terrain
43.	63544	63600	Radius-60	Hilly Terrain
44.	63713	63813	Radius-60	Hilly Terrain
45.	65563	65703	Radius-60	Hilly Terrain
46.	66458	66515	Radius-45	Hilly Terrain
47.	66523	66593	Radius-45	Hilly Terrain
48.	66597	66670	Radius-45	Hilly Terrain

(iv) Right of Way

Details of the Right of Way are given in Annex II of Schedule-A.

(v) Type of shoulders

(a) In open country paved shoulder of 2.5m & earthen shoulder of 1.5m width both sides shall be provided (Plain/Rolling terrain).

S.No.	Design Chainage		Paved Shoulder	Earthen Shoulder	Reference to cross section
	From km	To km			
1	46.597	47.520	2x2.5=5.0m	2x1.5=3.0m	Fig. 2.1

(b) In open country paved shoulder of 1.5m both side & earthen shoulder of 1.0m width on Valley sides shall be provided (Hilly terrain).

S. No.	Design Chainage		Paved Shoulder	Earthen Shoulder	Reference to cross section
	From km	To km			
1.	47.520	48.120	2x1.5=3.0m	1x1=1.0m	2.9
2.	48.120	49.220	2x1.5=3.0m	1x1=2.0m	2.8
3.	49.220	50.320	2x1.5=3.0m	1x2=2.0m	2.9
4.	50.420	52.320	2x1.5=3.0m	1x2=2.0m	2.9
5.	52.320	52.420	2x1.5=3.0m	1x2=2.0m	2.8
6.	52.420	54.300	2x1.5=3.0m	1x2=2.0m	2.9
7.	54.720	55.020	2x1.5=3.0m	1x2=2.0m	2.9a(New)
8.	55.120	55.220	2x1.5=3.0m	1x2=2.0m	2.9a(New)
9.	55.320	55.520	2x1.5=3.0m	1x2=2.0m	2.9a(New)
10.	55.670	55.920	2x1.5=3.0m	1x2=2.0m	2.9a(New)
11.	57.020	57.320	2x1.5=3.0m	1x2=2.0m	2.9a(New)
12.	57.620	57.720	2x1.5=3.0m	1x2=2.0m	2.9a(New)
13.	57.970	58.070	2x1.5=3.0m	1x2=2.0m	2.9a(New)

14.	58.120	58.220	2x1.5=3.0m	1x2=2.0m	2.9a(New)
15.	58.420	58.720	2x1.5=3.0m	1x2=2.0m	2.9a(New)
16.	59.270	59.820	2x1.5=3.0m	1x2=2.0m	2.9a(New)
17.	60.270	60.470	2x1.5=3.0m	1x2=2.0m	2.9a(New)
18.	60.720	60.870	2x1.5=3.0m	1x2=2.0m	2.9a(New)
19.	61.020	61.320	2x1.5=3.0m	1x2=2.0m	2.9a(New)
20.	61.420	62.070	2x1.5=3.0m	1x2=2.0m	2.9a(New)
21.	62.970	63.070	2x1.5=3.0m	1x2=2.0m	2.9a(New)
22.	63.270	63.470	2x1.5=3.0m	1x2=2.0m	2.9
23.	63.570	63.670	2x1.5=3.0m	1x2=2.0m	2.9
24.	64.070	64.470	2x1.5=3.0m	1x2=2.0m	2.9
25.	64.820	65.220	2x1.5=3.0m	1x2=2.0m	2.9
26.	65.420	65.570	2x1.5=3.0m	1x2=2.0m	2.9
27.	65.720	66.020	2x1.5=3.0m	1x2=2.0m	2.9
28.	66.470	66.845	2x1.5=3.0m	1x2=2.0m	2.9

(c) In open country paved shoulder of 2.0m both side with no earthen shoulder shall be provided (Hilly terrain).

S. No.	Design Chainage		Paved Shoulder	Reference to cross section
	From km	To km		
1.	50.320	50.420	2x2=4.0m	2.11(New)
2.	54.300	54.720	2x2=4.0m	2.11a(New)
3.	55.020	55.120	2x2=4.0m	2.11a(New)
4.	55.220	55.320	2x2=4.0m	2.11b(New)
5.	55.520	55.670	2x2=4.0m	2.11a(New)
6.	55.920	57.020	2x2=4.0m	2.11a(New)
7.	57.320	57.620	2x2=4.0m	2.11a(New)
8.	57.720	57.970	2x2=4.0m	2.11a(New)
9.	58.070	58.120	2x2=4.0m	2.11a(New)
10.	58.220	58.420	2x2=4.0m	2.11a(New)
11.	58.720	59.270	2x2=4.0m	2.11a(New)
12.	59.820	60.270	2x2=4.0m	2.11a(New)
13.	60.470	60.720	2x2=4.0m	2.11a(New)
14.	60.870	61.020	2x2=4.0m	2.11a(New)
15.	61.320	61.420	2x2=4.0m	2.11a(New)
16.	62.070	62.970	2x2=4.0m	2.11a(New)
17.	63.070	63.270	2x2=4.0m	2.11a(New)
18.	63.470	63.570	2x2=4.0m	2.11a(New)
19.	63.670	64.070	2x2=4.0m	2.11a(New)
20.	64.470	64.820	2x2=4.0m	2.11a(New)
21.	65.220	65.420	2x2=4.0m	2.11a(New)
22.	65.570	65.720	2x2=4.0m	2.11a(New)
23.	66.020	66.470	2x2=4.0m	2.11a(New)

(vi) Lateral and vertical clearances at underpasses

a) Lateral and vertical clearances at underpasses and provision of guardrails/crash barriers shall be as per paragraph 2.11 of the Manual.

b) Lateral clearance: The width of the opening at the underpasses shall be as follows:



S. No.	Location (Existing Chainage in km)	Span/ opening (m)	Remarks
NIL			

(vii) Lateral and vertical clearances at overpasses

a) Lateral and vertical clearances at overpasses shall be as per paragraph 2.12 of the Manual.

b) Lateral clearance: The width of the opening at the overpasses shall be as follows:

S. No.	Location (Chainage) (from km to	Span/ opening	Remarks
NIL			

(viii) Service roads

Service roads shall be constructed at the locations and for the lengths indicated below in accordance with paragraph 2.13 of the Manual.

Sl. No.	Location of service road (from km to km)	Right hand side (RHS)/Left hand side (LHS)/ or Both sides	Length (km) of service road
NIL			

(ix) Grade separated structures

a) Grade separated structures shall be provided as per paragraph 2.14 of the Manual. The requisite particulars are given below:

Sl. No.	Location of structure	Length (m)	Number and length of spans (m)	Approach gradient	Remarks, if any
NIL					

b) In the case of grade separated structures, the type of structure and the level of the Project Highway and the cross roads shall be as follows:

Sl. No.	Location	Type of structure Length (m)	Cross road at			Remarks, if any
			Existing Level	Raised Level	Lowered Level	
NIL						

(x) Cattle and pedestrian underpass /overpass

Cattle and pedestrian underpass/ overpass shall be constructed as follows: [Refer to paragraphs 2.14.3 of the Manual and specify the requirements of cattle and pedestrian underpass/ overpass]

Sl. No.	Location	Type of crossing
NIL		

## (xi) Typical cross-sections of the Project Highway

S.No	Ex. Ch.		Design Ch.		Design Length (km)	TCS as per IRC SP :73- 2015
	From	To	From	To		
1	87.000	87.930	46.597	47.520	0.923	2.1
2	87.930	88.620	47.520	48.120	0.600	2.9(New)
3	88.620	89.760	48.120	49.220	1.100	2.8
4	89.760	90.870	49.220	50.320	1.100	2.9(New)
5	90.870	91.000	50.320	50.420	0.100	2.11(New)
6	91.000	92.920	50.420	52.320	1.900	2.9(New)
7	92.920	93.020	52.320	52.420	0.100	2.8
8	93.020	94.890	52.420	54.300	1.880	2.9(New)
9	94.890	95.420	54.300	54.720	0.420	2.11a(New)
10	95.420	95.720	54.720	55.020	0.300	2.9a(New)
11	95.720	95.920	55.020	55.120	0.100	2.11a(New)
12	95.920	96.010	55.120	55.220	0.100	2.9a(New)
13	96.010	96.200	55.220	55.320	0.100	2.11b(New)
14	96.200	96.380	55.320	55.520	0.200	2.9a(New)
15	96.380	96.660	55.520	55.670	0.150	2.11a(New)
16	96.660	96.900	55.670	55.920	0.250	2.9a(New)
17	96.900	98.550	55.920	57.020	1.100	2.11a(New)
18	98.550	98.850	57.020	57.320	0.300	2.9a(New)
19	98.850	99.220	57.320	57.620	0.300	2.11a(New)
20	99.220	99.300	57.620	57.720	0.100	2.9a(New)
21	99.220	99.550	57.720	57.970	0.250	2.11a(New)
22	99.300	99.650	57.970	58.070	0.100	2.9a(New)
23	99.550	99.770	58.070	58.120	0.050	2.11a(New)
24	99.650	99.870	58.120	58.220	0.100	2.9a(New)
25	99.770	100.050	58.220	58.420	0.200	2.11a(New)
26	99.870	100.370	58.420	58.720	0.300	2.9a(New)
27	100.050	101.100	58.720	59.270	0.550	2.11a(New)
28	100.370	101.650	59.270	59.820	0.550	2.9a(New)
29	101.100	102.220	59.820	60.270	0.450	2.11a(New)
30	102.220	102.420	60.270	60.470	0.200	2.9a(New)
31	102.420	102.720	60.470	60.720	0.250	2.11a(New)
32	102.720	102.880	60.720	60.870	0.150	2.9a(New)
33	102.880	103.010	60.870	61.020	0.150	2.11a(New)
34	103.010	103.350	61.020	61.320	0.300	2.9a(New)
35	103.350	103.520	61.320	61.420	0.100	2.11a(New)
36	103.520	104.200	61.420	62.070	0.650	2.9a(New)
37	104.200	105.510	62.070	62.970	0.900	2.11a(New)
38	105.510	105.600	62.970	63.070	0.100	2.9a(New)
39	105.600	105.900	63.070	63.270	0.200	2.11a(New)
40	105.900	106.090	63.270	63.470	0.200	2.9(New)
41	106.090	106.250	63.470	63.570	0.100	2.11a(New)
42	106.250	106.380	63.570	63.670	0.100	2.9(New)
43	106.380	106.900	63.670	64.070	0.400	2.11a(New)
44	106.900	107.300	64.070	64.470	0.400	2.9(New)

45	107.300	107.700	64.470	64.820	0.350	2.11a(New)
46	107.700	108.100	64.820	65.220	0.400	2.9(New)
47	108.100	108.300	65.220	65.420	0.200	2.11a(New)
48	108.300	108.480	65.420	65.570	0.150	2.9(New)
49	108.480	108.730	65.570	65.720	0.150	2.11a(New)
50	108.730	109.020	65.720	66.020	0.300	2.9(New)
51	109.020	109.750	66.020	66.470	0.450	2.11a(New)
52	109.750	110.119	66.470	66.845	0.375	2.9(New)
Total Design Length					20.248	

### 3. Intersections and Grade Separators

All intersections and grade separators shall be as per Section 3 of the Manual. Existing intersections which are deficient shall be improved to the prescribed standards.

Properly designed intersections shall be provided at the locations and of the types and features given in the tables below:

(i) At-grade intersections

a) Major Junction - NIL

b) Minor Junctions – 10

S. No.	Location of intersection	Type of Intersection	Other features
1.	46+670	T-Type	Uricherra Village
2.	46+970	T-Type	School
3.	47+020	T-Type	Village Road
4.	47+100	T-Type	Village Road
5.	47+625	Y-Type	To Asst. Director of ARDD office
6.	47+740	T-Type	Village Road
7.	48+580	T-Type	Village Road
8.	62+535	T-Type	To Depta Cherra
9.	63+695	Y-Type	Sukna Cherra
10.	66+365	Y-Type	Tlakshi Village

(ii) Grade separated intersection with/without ramps

Sl. No.	Location	Salient features	Minimum length of viaduct to be provided	Road to be carried over/under the structures
NIL				

### 4. Road Embankment and Cut Section

- (i) Widening and improvement of the existing road embankment/cuttings and construction of new road embankment/ cuttings shall conform to the Specifications and Standards given in Section 4 of the Manual and the specified cross sectional details. Deficiencies in the plan and profile of the existing road shall be corrected.

**Note:-**

**1. Disposal of extra earth obtained by cutting is sole responsibility of contractor.**

**2. Indicative Muck disposal sites has been given in drawing volume but actual identification & finalization of disposal site is sole responsibility of contractor. The contractor has to acquire land if it is required.**

- (ii) Raising of the existing road

The existing road shall be raised in the following sections:

Sl. No.	Section (from km to km)	Length	Remarks
NIL			

## **5. Pavement Design**

- (i) Pavement design shall be carried out in accordance with Section 5 of the Manual.

- (ii) Type of pavement

Flexible Pavement shall be constructed in the entire length of project highway.

- (iii) Design requirements

- a) Design Period and strategy

Flexible pavement for new pavement or for widening and strengthening of the existing pavement shall be designed for a minimum design period of 20 years. Stage construction shall not be permitted.

- b) Design Traffic

Notwithstanding anything to the contrary contained in this Agreement or the Manual, the Contractor shall design the pavement for a design traffic of 30 million standard axles.

## **(iv) Reconstruction of stretches**

The following stretches of the existing road shall be reconstructed. These shall be designed as new pavement.

Existing chainage in km		Length (km)	Remarks
From	To		
46.597	66.845	20.248	
Total Length		20.248	

## **6. Roadside Drainage**

Drainage system including surface and subsurface drains for the Project Highway shall be provided as per Section 6 of the Manual.

- a) Hill side drainage

Sr. No.	Type of TCS	Chainage		Length (m) for both side	Total Length (m)
		From km	To km		
1.	2.9	47.520	48.120	1x600	600

Sr. No.	Type of TCS	Chainage		Length (m) for both	Total Length (m)
2.	2.8	48.120	49.220	1x 1100	1100
3.	2.9	49.220	50.320	1x 1100	1100
4.	2.11(New)	50.320	50.420	2x100	200
5.	2.9	50.420	52.320	1x 1900	1900
6.	2.8	52.320	52.420	1x 100	100
7.	2.9	52.420	54.300	1x 1880	1880
8.	2.11a(New)	54.300	54.720	2x420	840
9.	2.9a(New)	54.720	55.020	1x 300	300
10.	2.11a(New)	55.020	55.120	2x100	200
11.	2.9a(New)	55.120	55.220	1x 100	100
12.	2.11b(New)	55.220	55.320	2x100	200
13.	2.9a(New)	55.320	55.520	1x 200	200
14.	2.11a(New)	55.520	55.670	2x150	300
15.	2.9a(New)	55.670	55.920	1x 250	250
16.	2.11a(New)	55.920	57.020	2x1100	2200
17.	2.9a(New)	57.020	57.320	1x 300	300
18.	2.11a(New)	57.320	57.620	2x300	600
19.	2.9a(New)	57.620	57.720	1x 100	100
20.	2.11a(New)	57.720	57.970	2x 250	500
21.	2.9a(New)	57.970	58.070	1x 100	100
22.	2.11a(New)	58.070	58.120	2x 50	100
23.	2.9a(New)	58.120	58.220	1x 100	100
24.	2.11a(New)	58.220	58.420	2x 200	400
25.	2.9a(New)	58.420	58.720	1x 300	300
26.	2.11a(New)	58.720	59.270	2x 550	1100
27.	2.9a(New)	59.270	59.820	1x 550	550
28.	2.11a(New)	59.820	60.270	2x 450	900
29.	2.9a(New)	60.270	60.470	1x 200	200
30.	2.11a(New)	60.470	60.720	2x 250	500
31.	2.9a(New)	60.720	60.870	1x 150	150
32.	2.11a(New)	60.870	61.020	2x 150	300
33.	2.9a(New)	61.020	61.320	1x 300	300
34.	2.11a(New)	61.320	61.420	2x 100	200
35.	2.9a(New)	61.420	62.070	1x 650	650
36.	2.11a(New)	62.070	62.970	2x 900	1800
37.	2.9a(New)	62.970	63.070	1x 100	100
38.	2.11a(New)	63.070	63.270	2x200	400
39.	2.9	63.270	63.470	1x 200	200
40.	2.11a(New)	63.470	63.570	2x100	200
41.	2.9	63.570	63.670	1x 100	100

Sr. No.	Type of TCS	Chainage		Length (m) for both	Total Length (m)
42.	2.11a(New)	63.670	64.070	2x400	800
43.	2.9	64.070	64.470	1x 400	400
44.	2.11a(New)	64.470	64.820	2x350	700
45.	2.9	64.820	65.220	1x 400	400
46.	2.11a(New)	65.220	65.420	2x200	400
47.	2.9	65.420	65.570	1x 150	150
48.	2.11a(New)	65.570	65.720	2x150	300
49.	2.9	65.720	66.020	1x 300	300
50.	2.11a(New)	66.020	66.470	2x450	900
51.	2.9	66.470	66.845	1x 375	375
<b>Total Length</b>					<b>= 26345 m</b>

b) Catch water Drain

Sr. No.	Type of TCS	Chainage		Length (m) for both side	Total Length (m)
		From km	To km		
1.	2.9	47.520	48.120	1x600	600
2.	2.8	48.120	49.220	1x 1100	1100
3.	2.9	49.220	50.320	1x 1100	1100
4.	2.11(New)	50.320	50.420	2x100	200
5.	2.9	50.420	52.320	1x 1900	1900
6.	2.8	52.320	52.420	1x 100	100
7.	2.9	52.420	54.300	1x 1880	1880
8.	2.11a(New)	54.300	54.720	2x420	840
9.	2.9a(New)	54.720	55.020	1x 300	300
10.	2.11a(New)	55.020	55.120	2x100	200
11.	2.9a(New)	55.120	55.220	1x 100	100
12.	2.11b(New)	55.220	55.320	2x100	200
13.	2.9a(New)	55.320	55.520	1x 200	200
14.	2.11a(New)	55.520	55.670	2x150	300
15.	2.9a(New)	55.670	55.920	1x 250	250
16.	2.11a(New)	55.920	57.020	2x1100	2200
17.	2.9a(New)	57.020	57.320	1x 300	300
18.	2.11a(New)	57.320	57.620	2x300	600
19.	2.9a(New)	57.620	57.720	1x 100	100
20.	2.11a(New)	57.720	57.970	2x 250	500
21.	2.9a(New)	57.970	58.070	1x 100	100
22.	2.11a(New)	58.070	58.120	2x 50	100
23.	2.9a(New)	58.120	58.220	1x 100	100

Sr. No.	Type of TCS	Chainage		Length (m) for both	Total Length (m)
24.	2.11a(New)	58.220	58.420	2x 200	400
25.	2.9a(New)	58.420	58.720	1x 300	300
26.	2.11a(New)	58.720	59.270	2x 550	1100
27.	2.9a(New)	59.270	59.820	1x 550	550
28.	2.11a(New)	59.820	60.270	2x 450	900
29.	2.9a(New)	60.270	60.470	1x 200	200
30.	2.11a(New)	60.470	60.720	2x 250	500
31.	2.9a(New)	60.720	60.870	1x 150	150
32.	2.11a(New)	60.870	61.020	2x 150	300
33.	2.9a(New)	61.020	61.320	1x 300	300
34.	2.11a(New)	61.320	61.420	2x 100	200
35.	2.9a(New)	61.420	62.070	1x 650	650
36.	2.11a(New)	62.070	62.970	2x 900	1800
37.	2.9a(New)	62.970	63.070	1x 100	100
38.	2.11a(New)	63.070	63.270	2x200	400
39.	2.9	63.270	63.470	1x 200	200
40.	2.11a(New)	63.470	63.570	2x100	200
41.	2.9	63.570	63.670	1x 100	100
42.	2.11a(New)	63.670	64.070	2x400	800
43.	2.9	64.070	64.470	1x 400	400
44.	2.11a(New)	64.470	64.820	2x350	700
45.	2.9	64.820	65.220	1x 400	400
46.	2.11a(New)	65.220	65.420	2x200	400
47.	2.9	65.420	65.570	1x 150	150
48.	2.11a(New)	65.570	65.720	2x150	300
49.	2.9	65.720	66.020	1x 300	300
50.	2.11a(New)	66.020	66.470	2x450	900
51.	2.9	66.470	66.845	1x 375	375
<b>Total Length</b>					<b>= 26345 m</b>

## 7. Design of Structures

### (i) General

- a) All bridges, culverts and structures shall be designed and constructed in accordance with Section 7 of the Manual and shall conform to the cross- sectional features and other details specified therein.

b) Width of the carriageway of new bridges and structures shall be as follows:

S No.	Bridge at km	Width of carriageway and cross-sectional features
NIL		

c) The following structures shall be provided with footpaths:

Sl. No.	Location at km	Remarks
NIL		

d) All bridges shall be high-level bridges.

e) The following structures shall be designed to carry utility services specified in table below:

Sl. No.	Bridge at km	Utility service to be carried	Remarks
NIL			

f) Cross-section of the new culverts and bridges at deck level for the Project Highway shall conform to the typical cross-sections given in section 7 of the Manual.

## (ii) Culverts

- Overall width of all culverts shall be equal to the roadway width of the approaches.
- Reconstruction of existing culverts:

The existing culverts at the following locations shall be re-constructed as new culverts:

Sl.No.	Culvert Location	Span/Opening (m)	Remark , if any
1	46+830	1no. 5x5	
2	46+975	1no. 2x3	
3	51+560	1no. 2X2	
4	52+370	1no. 2x2	
5	53+150	1no. 2X3	
6	55+310	1no. 2x2	
7	55+990	1no. 3x3	
8	56+170	1no. 2x2	
9	56+190	1no. 2x2	
10	56+290	1no. 2x2	
11	56+440	1no. 3x3	
12	57+310	1no. 2X2	
13	57+960	1no. 2X2	
14	58+420	1no. 2x2	
15	58+490	2no. 3X3	
16	59+290	1no. 2X2	
17	60+730	1no. 2X2	
18	60+890	1no. 3X3	



19	61+030	1no. 2X2	
20	62+090	1no. 2X2	
21	62+310	1no. 2X2	
22	62+490	1no. 5X5	
23	62+590	1no. 2X2	
24	63+090	1no. 2X2	
25	63+190	1no. 2X2	
26	63+390	1no. 2X2	
27	63+450	1no. 2X2	
28	65+770	1no. 2X2	
29	66+090	1no. 2x2	
30	66+270	1no. 2x2	

c) Widening of existing culverts:

All existing culverts which are not to be reconstructed shall be widened to the roadway width of the Project Highway as per the typical cross section given in section 7 of the Manual. Repairs and strengthening of existing structures where required shall be carried out.

Sl. No.	Culvert location	Type, span, height and width of existing culvert (m)	Repairs to be carried out [specify]
NIL			

d) Additional new culverts shall be constructed as per particulars given in the table below:

S.No.	Culvert Location	Span/ Opening (m)
1.	47+570	1no. 2x2
2.	48+000	1no. 2x2
3.	48+250	1no. 2x2
4.	48+400	1no. 2x2
5.	48+690	1no. 2x2
6.	49+700	1no. 2x2
7.	49+900	1no. 2x2
8.	50+200	1no. 2x2
9.	50+445	1no. 2x2
10.	50+700	1no. 2x2
11.	51+100	1no. 2X2
12.	51+400	1no. 2X2
13.	51+800	1no. 2X2
14.	52+100	1no. 2X2
15.	52+600	1no. 2X2
16.	52+860	1no. 2x2
17.	53+600	1no. 2x2
18.	53+800	1no. 2x2
19.	54+400	1no. 2x2
20.	54+540	1no. 2x2
21.	54+710	1no. 2x2

22.	54+840	1no. 2x2
23.	55+850	1no. 2x2
24.	56+800	1no. 2x2
25.	57+100	1no. 2x2
26.	57+500	1no. 2x2
27.	57+690	1no. 2x2
28.	58+750	1no. 2x2
29.	59+130	1no. 2x2
30.	59+770	1no. 2x2
31.	61+310	1no. 2x2
32.	61+910	1no. 2x2
33.	62+430	1no. 2x2
34.	62+570	1no. 2x2
35.	62+810	1no. 2x2
36.	63+170	1no. 2x2
37.	64+190	1no. 2x2
38.	64+650	1no. 2x2
39.	65+000	1no. 2x2
40.	65+450	1no. 2x2
41.	66+530	1no. 2x2

- e) Repairs/replacements of railing/parapets, flooring and protection works of the existing culverts shall be undertaken as follows:

Sl. No.	Location at km	Type of repair required
NIL		

- f) Floor protection works shall be as specified in the relevant IRC Codes and Specifications.

(iii) Bridges

- a) Existing bridges to be re- constructed/widened

- (i) The existing bridges at the following locations shall be re-constructed as new Structures

Sl. No.	Bridge location (km)	Salient details of existing bridge	Adequacy or otherwise of the existing waterway, vertical clearance, etc	Remarks
NIL				

- (ii) The following narrow bridges shall be widened:

Sl. No.	Location (km)	Existing width (m)	Extent of widening (m)	Cross-section at deck level for widening
NIL				

b) Additional new bridges

New bridges at the following locations on the Project Highway shall be constructed.

Sl. No.	Location (km)	Total length (m)	Remarks, if any
NIL			

c) The railings of existing bridges shall be replaced by crash barriers at the following locations:

Sl. No.	Location at km	Remarks
NIL		

d) Repairs/replacements of railing/parapets of the existing bridges shall be undertaken as follows:

Sl. No.	Location at km	Remarks
NIL		

e) Drainage system for bridge decks

An effective drainage system for bridge decks shall be provided as specified in paragraph 7.21 of the Manual

f) Structures in marine environment- Nil

(iv) Rail-road bridges

a) Design, construction and detailing of ROB/RUB shall be as specified in section 7 of the Manual.

b) Road over-bridges

Road over-bridges (road over rail) shall be provided at the following level crossings, as per GAD drawings attached:

Sl. No.	Location of Level crossing (Chainage km)	Length of bridge (m)
NIL		

c) Road under-bridges

Road under-bridges (road under railway line) shall be provided at the following level crossings, as per GAD drawings attached:

Sl. No.	Location of Level crossing (Chainage km)	Number and length of span (m)
Nil		

(v) Grade separated structures

The grade separated structures shall be provided at the locations and of the type and length specified in paragraphs 2.9 and 3 of this Annex-I.

(vi) Repairs and strengthening of bridges and structures

The existing bridges and structures to be repaired/strengthened, and the nature and extent of repairs /strengthening required are given below:

(a) Bridges

Sl. No.	Location of bridge (km)	Nature and extent of repairs /strengthening to be carried out
NIL		

(b) ROB / RUB

Sl. No.	Location of ROB/RUB (km)	Nature and extent of repairs /strengthening to be carried out
NIL		

(c) Overpasses/Underpasses and other structures

Sl. No.	Location of Structure (km)	Nature and extent of repairs /strengthening to be carried out
NIL		

(vii) List of Major Bridges and Structures

The following is the list of the Major Bridges and Structures:

Sl. No.	Location	Remarks
NIL		

**8. Traffic Control Devices and Road Safety Works**

- (i) Traffic control devices and road safety works shall be provided in accordance with Section 9 of the Manual.
- (ii) Specifications of the reflective sheeting. As per section 9.2 of the Manual of Specifications and Standards

**9. Roadside Furniture**

- (i) Roadside furniture shall be provided in accordance with the provisions of Section 11 of the Manual. However the Contractor shall provide minimum numbers of Cautionary, Mandatory, Warning and Informatory Traffic Sign Boards as mentioned below:

- (ii) Overhead traffic signs: location and size  
As per paragraph 11.5 of the Manual

## 10. Compulsory Afforestation

Refer to Clause 11 of the Manual. 1:3 times new trees to be planted by the Contractor as compulsory afforestation.

## 11. Hazardous Locations

The Crash barriers shall also be provided at the following hazardous locations:

Sl. No.	Location stretch from (km) to (km)		LHS/RHS
1.	47.520	48.12	On Valley Side as per TCS
2.	48.120	49.22	On Valley Side as per TCS
3.	49.220	50.32	On Valley Side as per TCS
4.	50.420	52.32	On Valley Side as per TCS
5.	52.320	52.42	On Valley Side as per TCS
6.	52.420	54.3	On Valley Side as per TCS
7.	54.720	55.02	On Valley Side as per TCS
8.	55.120	55.22	On Valley Side as per TCS
9.	55.320	55.52	On Valley Side as per TCS
10.	55.670	55.92	On Valley Side as per TCS
11.	57.020	57.32	On Valley Side as per TCS
12.	57.620	57.72	On Valley Side as per TCS
13.	57.970	58.07	On Valley Side as per TCS
14.	58.120	58.22	On Valley Side as per TCS
15.	58.420	58.72	On Valley Side as per TCS
16.	59.270	59.82	On Valley Side as per TCS
17.	60.270	60.47	On Valley Side as per TCS
18.	60.720	60.87	On Valley Side as per TCS
19.	61.020	61.32	On Valley Side as per TCS
20.	61.420	62.07	On Valley Side as per TCS
21.	62.970	63.07	On Valley Side as per TCS
22.	63.270	63.47	On Valley Side as per TCS
23.	63.570	63.67	On Valley Side as per TCS
24.	64.070	64.47	On Valley Side as per TCS
25.	64.820	65.22	On Valley Side as per TCS
26.	65.420	65.57	On Valley Side as per TCS
27.	65.720	66.02	On Valley Side as per TCS
28.	66.470	66.845	On Valley Side as per TCS

## 12. Special Requirement for Hill Roads

[Refer to paragraphs 14.5 and 14.8 of the Manual and provide details where relevant and required.]

Special requirement for hill roads in accordance with the provisions of section 14 of the manual shall be provided in the following locations:-

a) Retaining Wall

S.No.	Location stretch		LHS/RHS	Remarks
	From	To		
1.	48.100	48.400	RHS	Hilly portion. Retaining wall shall be designed and provided as per the technical requirement in consultation with the Authority Engineer subject to minimum length of 5415 metre.
2.	48.400	48.500	LHS	
3.	48.500	48.550	RHS	
4.	48.550	48.600	LHS	
5.	48.650	48.750	RHS	
6.	48.750	48.800	LHS	
7.	48.800	49.250	BS	
8.	49.250	49.450	LHS	
9.	49.750	49.750	LHS	
10.	49.870	50.050	RHS	
11.	50.050	50.200	BS	
12.	50.200	50.300	RHS	
13.	50.450	50.520	LHS	
14.	50.520	50.700	LHS	
15.	50.700	50.800	BS	
16.	51.100	51.400	RHS	
17.	51.950	52.050	RHS	
18.	52.150	52.250	RHS	
19.	52.350	52.400	LHS	
20.	52.600	52.700	RHS	
21.	53.300	53.450	RHS	
22.	53.450	53.700	RHS	
23.	53.700	53.800	BS	
24.	53.920	54.000	RHS	
25.	54.400	54.430	BS	
26.	54.550	54.580	LHS	
27.	54.710	54.730	LHS	
28.	54.820	54.850	LHS	
29.	55.310	55.350	LHS	
30.	57.000	57.100	LHS	
31.	57.150	57.250	LHS	
32.	57.300	57.320	LHS	
33.	57.620	57.630	LHS	
34.	58.000	58.070	LHS	
35.	58.130	58.200	LHS	
36.	58.490	58.510	LHS	
37.	59.490	59.510	LHS	
38.	59.640	59.660	LHS	
39.	59.830	59.850	LHS	
40.	59.990	60.010	LHS	

41	60.270	60.310	LHS	
42	60.400	60.490	LHS	
43	60.600	60.620	LHS	
44	61.300	61.340	LHS	
45	62.610	62.640	LHS	
46	62.890	62.910	LHS	
47	63.150	63.170	LHS	
48	63.330	63.350	LHS	
49	64.550	64.600	RHS	
50	65.500	65.580	LHS	
51	66.550	66.700	RHS	
52	66.750	66.845	LHS	

b) Breast wall

Sl. No.	Location stretch		LHS/RHS
	From (km)	To (km)	
1	54.300	54.720	As per TCS
2	54.720	55.020	As per TCS
3	55.020	55.120	As per TCS
4	55.120	55.220	As per TCS
5	55.220	55.320	As per TCS
6	55.320	55.520	As per TCS
7	55.520	55.670	As per TCS
8	55.670	55.920	As per TCS
9	55.920	57.020	As per TCS
10	57.020	57.320	As per TCS
11	57.320	57.620	As per TCS
12	57.620	57.720	As per TCS
13	57.720	57.970	As per TCS
14	57.970	58.070	As per TCS
15	58.070	58.120	As per TCS
16	58.120	58.220	As per TCS
17	58.220	58.420	As per TCS
18	58.420	58.720	As per TCS
19	58.720	59.270	As per TCS
20	59.270	59.820	As per TCS
21	59.820	60.270	As per TCS
22	60.270	60.470	As per TCS
23	60.470	60.720	As per TCS
24	60.720	60.870	As per TCS
25	60.870	61.020	As per TCS
26	61.020	61.320	As per TCS
27	61.320	61.420	As per TCS
28	61.420	62.070	As per TCS
29	62.070	62.970	As per TCS
30	62.970	63.070	As per TCS
31	63.070	63.270	As per TCS
32	63.470	63.570	As per TCS

33	63.670	64.070	As per TCS
34	64.470	64.820	As per TCS
35	65.220	65.420	As per TCS
36	65.570	65.720	As per TCS
37	66.020	66.470	As per TCS

### 13. Change of Scope

The length of Structures and bridges specified hereinabove shall be treated as an approximate assessment. The actual lengths as required on the basis of detailed investigations shall be determined by the Contractor in accordance with the Specifications and Standards. Any variations in the lengths specified in this Schedule-B shall not constitute a Change of Scope, save and except any variations in the length arising out of a Change of Scope expressly undertaken in accordance with the provisions of Article 13.



**(Schedule – B – 1)**

1. The shifting of utilities and felling of trees shall be carried out by the Contractor. The cost of the same shall be borne by the Authority. The details of utilities are as follows:

Sr. No	Type of Utility	Unit	Quantity	Location/stretch h (LHS/RHS)
A	Electrical Utilities		As Per TSECL & DWS Estimates	
A1	Electrical Poles	Nos.		
A2	Electrical cables	meters		
A3	Transformers	Nos.		
-	-----	-		
-	-----	-		
B	Water/Sewage pipeline			
B1	Sewage	meters		
B2	Water supply	meters		
-	-----	-		
-	-----	-		
C	Felling of Tress	Nos.		

## Schedule - C

(See Clause 2.1)

### Project Facilities

#### 1. Project Facilities

The Contractor shall construct the Project Facilities in accordance with the provisions of this Agreement. Such Project Facilities shall include:

- (a) toll plaza[s];
- (b) roadside furniture;
- (c) pedestrian facilities;
- (d) tree plantation;
- (e) truck lay-byes;
- (f) bus-bays and bus shelters;
- (g) rest areas; and
- (h) others to be specified

#### 2. Description of Project Facilities

Each of the Project Facilities is described below:

Bus Shelter: - 3 No. Of Bus Shelter is proposed in the project road.

Sr. No.	Project Facility	Location	Design Requirement	Other essential details
1	Bus Shelter	48.450		Kanchanpur
2	Bus Shelter	64.050		Manpui
3	Bus Shelter	66.450		Tlakchi

Provide adequate details of each Project Facility to ensure their design and completion in accordance with the project-specific requirements and the provisions of the Manual.

## **Schedule - D**

(See Clause 2.1)

### **Specifications and Standards**

#### **1. Construction**

The Contractor shall comply with the Specifications and Standards set forth in Annex- I of this Schedule-D for construction of the Project Highway.

#### **2. Design Standards**

[Manual of Specifications and Standards for Two Laning of Highways (IRC: SP: 73-2018), referred to herein as the Manual]

## **Annex – I**

(Schedule-D)

### **Specifications and Standards for Construction**

#### **1. Specifications and Standards**

All Materials, works and construction operations shall conform to the Manual of Specifications and Standards for Two-Laning of Highways (IRC:SP:73-2018), referred to as the Manual, and MORTH Specifications for Road and Bridge Works. Where the specification for a work is not given, Good Industry Practice shall be adopted to the satisfaction of the Authority's Engineer.

#### **2. Deviations from the Specifications and Standards**

(i) The terms “Concessionaire”, “Independent Engineer” and “Concession Agreement” used in the Manual shall be deemed to be substituted by the terms “Contractor”, “Authority's Engineer” and “Agreement” respectively.

(ii) [Notwithstanding anything to the contrary contained in Paragraph 1 above, the following Specifications and Standards shall apply to the Project Highway, and for purposes of this Agreement, the aforesaid Specifications and Standards shall be deemed to be amended to the extent set forth below:]

(iii) [Note 1: Deviations from the aforesaid Specifications and Standards shall be listed out here. Such deviations shall be specified only if they are considered essential in view of project-specific requirements.]


Sr. No.	Cl. No.	Provisions in Clause	Deviation from Manual
1	TCS-2.11a(New)	New Typical Cross Section	Two-Lane with with paved shoulder in Hilly Terrain with Hill side Drain on Both sides and breast wall on one side in open Country area (Box cut)
2	TCS-2.11b(New)	New Typical Cross Section	Two-Lane with with paved shoulder in Hilly Terrain with Hill side Drain and breast wall on both sides in open Country area (Box cut)
3	TCS-2.11(New)	New Typical Cross Section	Two-Lane with with paved shoulder in Hilly Terrain with Hill side Drain on Both sides in open Country area (Box cut)
4	TCS-2.9a(New)	New Typical Cross Section	Two Lane Road with Paved shoulders in Hilly Terrain with Hill side drain and breast wall

With Reference to clause no. 2.9.4 of IRC SP 73-2015, Radius of horizontal curve is restricted at locations listed below:-


Sl. No.	Stretch		Radius of Curve(m)	Remarks
	From	To		
49.	47164	47279	200	P/R terrain (builtup)
50.	47281	47417	200	P/R terrain (builtup)
51.	47723	47839	90	P/R terrain (builtup)
52.	47858	47925	155	P/R terrain (builtup)
53.	48150	48230	45	Hilly Terrain
54.	48401	48505	60	Hilly Terrain
55.	48806	48922	50	Hilly Terrain
56.	48951	49124	50	Hilly Terrain
57.	49125	49193	50	Hilly Terrain
58.	50067	50164	60	Hilly Terrain
59.	50802	50993	60	Hilly Terrain
60.	51033	51117	45	Hilly Terrain
61.	51497	51643	45	Hilly Terrain
62.	52140	52234	60	Hilly Terrain
63.	52277	52471	60	Hilly Terrain
64.	53069	53230	45	Hilly Terrain
65.	53866	54040	60	Hilly Terrain
66.	55145	55219	60	Hilly Terrain
67.	55219	55352	60	Hilly Terrain
68.	55358	55496	50	Hilly Terrain
69.	56398	56567	60	Hilly Terrain
70.	56583	56667	60	Hilly Terrain
71.	56698	56761	60	Hilly Terrain
72.	56774	56825	60	Hilly Terrain
73.	56877	56980	30	Hilly Terrain
74.	57259	57379	45	Hilly Terrain
75.	57533	57637	60	Hilly Terrain
76.	57645	57747	60	Hilly Terrain
77.	57921	58023	45	Hilly Terrain
78.	58044	58140	30	Hilly Terrain
79.	59713	59832	60	Hilly Terrain
80.	59930	60098	50	Hilly Terrain
81.	60591	60654	60	Hilly Terrain
82.	60973	60809	60	Hilly Terrain
83.	61266	61328	60	Hilly Terrain
84.	61330	61433	45	Hilly Terrain
85.	61463	61549	60	Hilly Terrain
86.	61592	61724	40	Hilly Terrain
87.	61781	61849	60	Hilly Terrain
88.	63189	63311	60	Hilly Terrain
89.	63318	63430	60	Hilly Terrain
90.	63454	63539	60	Hilly Terrain
91.	63544	63600	60	Hilly Terrain

92.	63713	63813	60	Hilly Terrain
93.	65563	65703	60	Hilly Terrain
94.	66458	66515	45	Hilly Terrain
95.	66523	66593	45	Hilly Terrain
96.	66597	66670	45	Hilly Terrain


## Typical Cross Sections

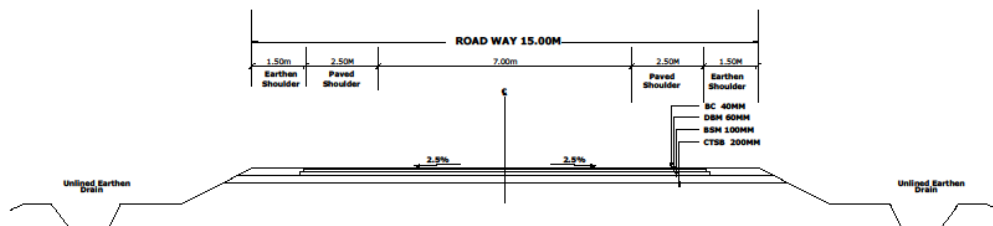


**Fig - 2.1**  
**Typical Cross Section**  
**(Open Country - Plain/Rolling Terrain)**  
**2-lane Carriageway (With Paved**  
**Shoulders) Without service road**

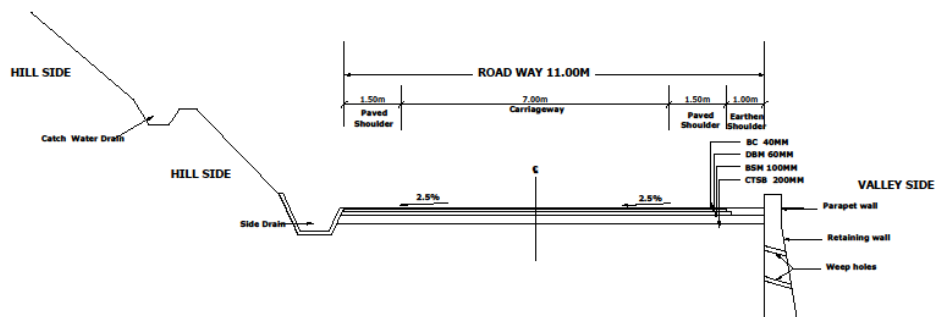

**Fig - 2.8**  
**Typical Cross Section (Hilly Terrain)**  
**2-lane carriageway (With Paved Shoulder)**  
**(With Drain on Hill Side & Retaining Wall on Valley Side)**

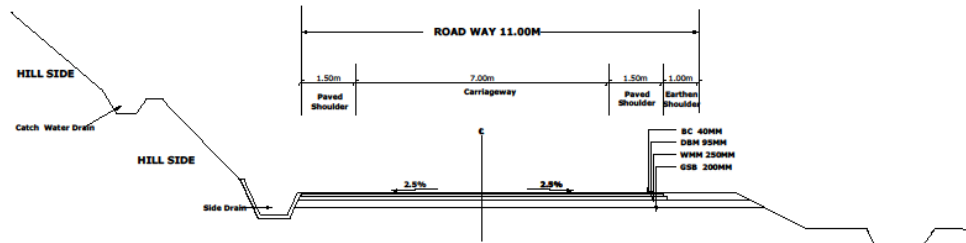


**Fig - 2.9**  
**Typical Cross Section (Hilly Terrain)**  
**(With Hill Side Drain One Side)**  
**2- lane Carriageway (With Paved Shoulders)**

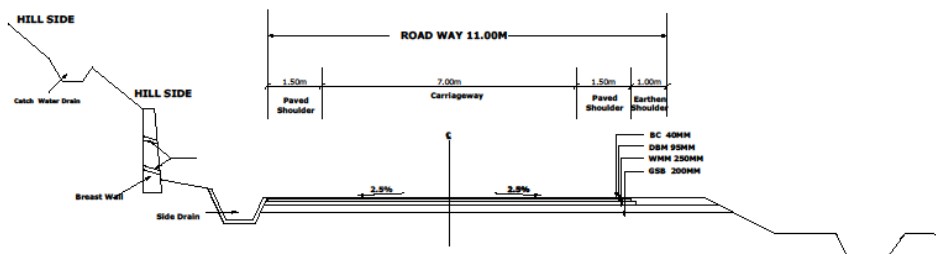


**Fig - 2.9A (NEW)**  
**Typical Cross Section (Hilly Terrain)**  
**(With Hill Side Drain One Side)**  
**2- lane Carriageway (With Paved Shoulders)**




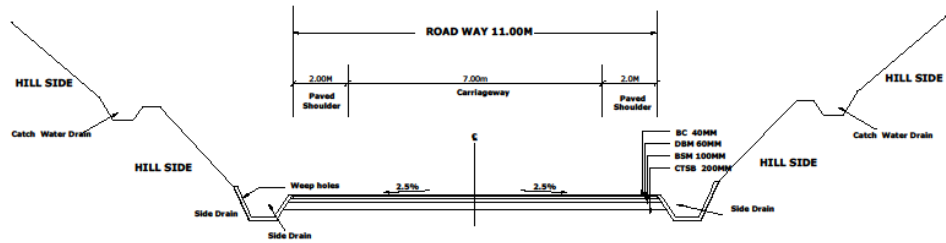

**Fig - 2.11(new)**  
**Typical Cross Section (Hilly Terrain)**  
**2-lane Carriageway (With Paved Shoulders) Box Cut**  
**Without Breast Wall**

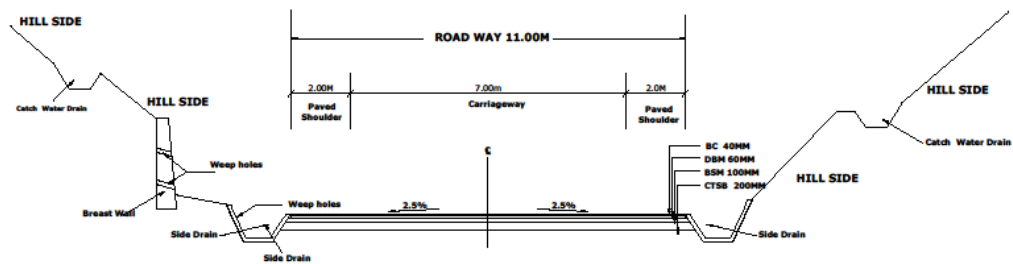

**Fig - 2.11A(new)**  
**(Hilly Terrain) Typical Cross Section**  
**2-lane Carriageway (With Paved Shoulders) Box Cut**  
**With one side Breast Wall**

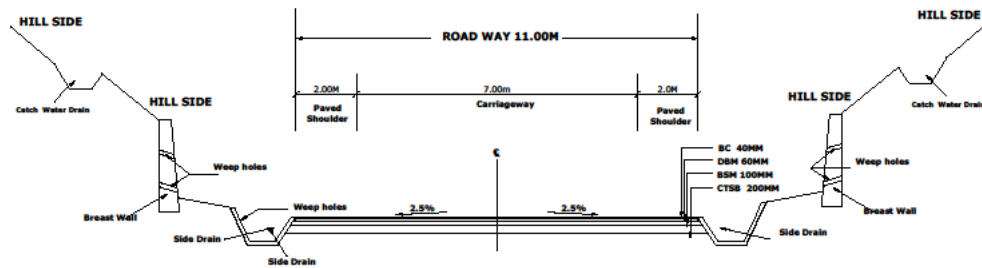

**Fig - 2.11B(new)**  
**Typical Cross Section (Hilly Terrain)**  
**2-lane Carriageway (With Paved Shoulders) Box Cut**  
**With both side Breast Wall**

## Schedule - E

(See Clauses 2.1 and 14.2)

### Maintenance Requirements

#### 1. Maintenance Requirements

- (i) The Contractor shall, at all times maintain the Project Highway in accordance with the provisions of this Agreement, Applicable Laws and Applicable Permits.
- (ii) The Contractor shall repair or rectify any Defect or deficiency set forth in Paragraph 2 of this Schedule-E within the time limit specified therein and any failure in this behalf shall constitute non-fulfilment of the Maintenance obligations by the Contractor. Upon occurrence of any breach hereunder, the Authority shall be entitled to effect reduction in monthly lump sum payment as set forth in Clause 14.6 of this Agreement, without prejudice to the rights of the Authority under this Agreement, including Termination thereof.
- (iii) All Materials, works and construction operations shall conform to the MORTH Specifications for Road and Bridge Works, and the relevant IRC publications. Where the specifications for a work are not given, Good Industry Practice shall be adopted.

#### 2. Repair/rectification of Defects and deficiencies

The obligations of the Contractor in respect of Maintenance Requirements shall include repair and rectification of the Defects and deficiencies specified in Annex - I of this Schedule-E within the time limit set forth therein.

#### 3. Other Defects and deficiencies

In respect of any Defect or deficiency not specified in Annex - I of this Schedule-E, the Authority's Engineer may, in conformity with Good Industry Practice, specify the permissible limit of deviation or deterioration with reference to the Specifications and Standards, and any deviation or deterioration beyond the permissible limit shall be repaired or rectified by the Contractor within the time limit specified by the Authority's Engineer.

#### 4. Extension of time limit

Notwithstanding anything to the contrary specified in this Schedule-E, if the nature and extent of any Defect or deficiency justifies more time for its repair or rectification than the time specified herein, the Contractor shall be entitled to additional time in conformity with Good Industry Practice. Such additional time shall be determined by the Authority's Engineer and conveyed to the Contractor and the Authority with reasons thereof.

#### 5. Emergency repairs/restoration

Notwithstanding anything to the contrary contained in this Schedule-E, if any Defect, deficiency or deterioration in the Project Highway poses a hazard to safety or risk of damage to property, the Contractor shall promptly take all reasonable measures for eliminating or minimizing such danger.

6. Daily inspection by the Contractor

The Contractor shall, through its engineer, undertake a daily visual inspection of the Project Highway and maintain a record thereof in a register to be kept in such form and manner as the Authority's Engineer may specify. Such record shall be kept in safe custody of the Contractor and shall be open to inspection by the Authority and the Authority's Engineer at any time during office hours.

7. Pre-monsoon inspection / Post-monsoon inspection

The Contractor shall carry out a detailed pre-monsoon inspection of all bridges, culverts and drainage system before 1st May every year in accordance with the guidelines contained in IRC: SP35. Report of this inspection together with details of proposed maintenance works as required on the basis of this inspection shall be sent to the Authority's Engineer before the 10th May every year. The Contractor shall complete the required repairs before the onset of the monsoon and send to the Authority's Engineer a compliance report. Post monsoon inspection shall be done by the 30th September and the inspection report together with details of any damages observed and proposed action to remedy the same shall be sent to the Authority's Engineer.

8. Repairs on account of natural calamities

All damages occurring to the Project Highway on account of a Force Majeure Event or wilful default or neglect of the Authority shall be undertaken by the Authority at its own cost. The Authority may instruct the Contractor to undertake the repairs at the rates agreed between the Parties.

Asset Type	Performance Parameter	Level of Service (LOS)		Frequency of Inspection	Tools/Equipment	Standards and References for Inspection and Data Analysis	Time limit for Rectification/ Repair	Maintenance Specifications
		Desirable	Acceptable					
Flexible Pavement (Pavement of MCW, Service Road, approaches of Grade structure, approaches of connecting roads, slip roads, lay byes etc. as applicable)	Potholes	Nil	< 0.1 % of area and subject to limit of 10 mm indepth	Daily	Length Measurement Unit like Scale, Tape, odometer etc.	IRC 82: 2015 and Distress Identification Manual for Long Term Pavement Performance Program, FHWA 2003 (http://www.tfhrc.com/pavement/ltp/reports/03031/)	24-48 hours	MORT&H Specification 3004.2
	Cracking	Nil	< 5 % subject to limit of 0.5 sqm for any 50 m length	Daily			7-15 days	MORT&H Specification 3004.3
	Rutting	Nil	< 5 mm	Daily	Straight Edge		15 -30 days	MORT&H Specification 3004.2
	Corrugations and Shoving	Nil	< 0.1 % of area	Daily	Length Measurement Unit like		2-7 days	IRC:82- 2015
	Bleeding	Nil	< 0.1 % of area	Daily	Scale, Tape, odometer etc.		3-7 days	MORT&H Specification 3004.4
	Raveling / Stripping	Nil	< 0.1 % of area	Daily			7-15 days	IRC:82- 2015 read with IRC SP 81
	Edge Deformation/ Breaking	Nil	< 1 m for any 100 m section and width < 0.1 m at any location, restricted to 30 cm from the edge	Daily	Scale, Tape, odometer etc.		IRC:82- 2015	
	Roughness BI	2000 mm/km	2400 mm/km	Bi-Annually	Class I Profilometer SCRM (Sideway-force Coefficient	Class I Profilometer : ASTM E950 (98) :2004 –Standard Test Method for measuring Longitudinal Profile of Travelled Surfaces with Accelerometer Established Inertial Profiling Reference	180 days	IRC:82-2015
	Skid Number	60SN	50SN	Bi-Annually			180 days	BS: 7941-1: 2006
	Pavement	3	2.1	Bi-			180 days	IRC:82- 2015

	Condition Index			Annually	Routine Investigation Machine or equivalent)	ASTM E1656 -94: 2000- Standard Guide for Classification of Automatic Pavement Condition Survey Equipment		
	Other Pavement Distresses			Bi-Annually			2-7 days	IRC:82- 2015
	Deflection/ Remaining Life			Annually	Falling Weight Deflect meter	IRC 115: 2014	180 days	IRC:115-2014
Rigid Pavement (Pavement of MCW, Service Road, Grade Structure, approaches of connecting roads, slip roads, lay byes etc. as applicable)	Roughness BI	2200m m/km	2400mm /km	Bi-Annually	Class I Profilometer	ASTM E950 (98) :2004 and ASTM E1656 - 94: 2000	180 days	IRC:SP:83-2008
	Skid	Skid Resistance no. at different speed of vehicles		Bi-Annually	SCRIM  (Sideway-force Coefficient Routine Investigation Machine or equivalent)	RC:SP:83-2008	180 days	IRC:SP:83-2008
		Minimum SN	Traffic Speed (Km/h)					
		36	50					
		33	65					
		32	80					
		31	95					
		31	110					
Embankment/ Slope	Edge drop at shoulders	Nil	40 mm	Daily	Length Measurement Unit like	IRC	7-15 days	MORT&H Specification 408.4

					Scale, Tape, odometer etc.			
	Slope of camber/cross fall	Nil	<2% variation in prescribed slope of camber /cross fall	Daily			7-15 days	MORT&H Specification 408.4
	Embankment Slopes	Nil	<15 % variation in prescribe side slope	Daily			7-15 days	MORT&H Specification 408.4
	Embankment Protection	Nil	Nil	Daily	NA		7-15 days	MORT&H Specification
	Rain Cuts/ Gullies in slope	Nil	Nil	Daily Specially During Rainy Season	NA		7-15 days	MORT&H Specification

In addition to the above performance criterion, the contractor shall strictly maintain the rigid pavements as per requirements in the following table

**Table -2: Maintenance Criteria for Rigid Pavements:**

S.No .	Type of Distress	Measured Parameter	Degree of Severity	Assessment Rating	Repair Action		
					For the case d < D/2 Short Term	For the case d > D/2 Long Term	
CRACKING							
1.	Single Discrete Cracks Not intersecting with any joint	w = width of crack L = length of crack d = depth of crack D = depth of slab	0	Nil, not discernible	No Action	Not applicable	
			1	w < 0.2 mm. hair cracks			
			2	w = 0.2 - 0.5 mm, discernible from slow-moving car			
				3	w = 0.5 - 1.5 mm, discernible from fast-moving car	Seal without delay	Within 7days
				4	w = 1.5 - 3.0 mm	Seal, and stitch if L > l m.	Staple or Dowel Bar Retrofit, FDR for affected portion.
			5	w > 3 mm.	Within 7 days	Within 15days	
2.	Single Transverse (or Diagonal) Crack intersecting with one or more joints	w = width of crack L = length of crack d = depth of crack D = depth of slab	0	Nil, not discernible	No Action		
			1	w < 0.2 mm, hair cracks	Route and seal with epoxy.	Staple or Dowel Bar Retrofit.	
					Within 7 days	Within 15 days	
			3	w = 0.2 - 0.5 mm, discernible from slow vehicle	Route, seal and stitch, if L > 1 m.		
					Within 7 days		
4	w = 3.0 - 6.0 mm	Dowel Bar Retrofit.	Full Depth Repair				



			5	w > 6 mm, usually associated with spalling, and/or slab rocking under traffic	<p>Within 15 days</p> <p>Not Applicable, as it may be full depth</p>	<p>Dismantle and reconstruct affected.</p> <p>Portion with norms and specifications - See Para 5.5 &amp; 9.2</p> <p>Within 15days</p>
3	Single Longitudinal Crack intersecting with one or more joints	w = width of crack L = length of crack d = depth of crack D = depth of slab	0	Nil, not discernible	No Action	
			1	w < 0.5 mm, discernible from slow moving vehicle	<p>Seal with epoxy, if L &gt; 1 m.</p> <p>Within 7 days</p>	<p>Staple or dowel bar retrofit.</p> <p>Within 15days</p>
			2	w = 0.5 - 3.0 mm, discernible from fast vehicle	<p>Route seal and stitch, if L &gt; 1 m.</p> <p>Within 15 days</p>	
			3	w = 3.0 – 6.0 mm	<p>Staple, if L &gt; 1 m.</p> <p>Within 15 days</p>	<p>Partial Depth Repair with stapling.</p> <p>Within 15days</p>
			4	w = 6.0 - 12.0 mm, usually associated with spalling	<p>Not Applicable, as it may be full depth</p>	<p>Full Depth Repair</p>
			5	w > 12 mm, usually associated with spalling, and/or slab rocking under traffic	<p>Not Applicable, as it may be full depth</p>	<p>Dismantle and reconstruct affected portion as per norms and specifications - See Para 5.6.4</p> <p>Within 15days</p>

4	Multiple Cracks intersecting with one or more joints	w = width of crack	0	Nil, not discernible	No Action	
			1	w < 0.2 mm, hair cracks	Seal, and stitch if L > 1 m.	
			2	w = 0.2 - 0.5 mm. discernible from slow vehicle	Within 15 days	
			3	w = 0.5 - 3.0 mm, discernible from fast vehicle	Full depth repair within 15 days	Dismantle, Reinstatement Sub-base, Reconstruct whole slab as per specifications within 30 days
			4	w = 3.0 - 6.0 mm panel broken into 2 or 3 pieces		
			5	w > 6 mm and/or panel broken into more than 4 pieces		
5	Corner Break	w = width of crack L = length of crack	0	Nil, not discernible	No Action	
			1	w < 0.5 mm; only 1 corner broken	Seal with low viscosity epoxy to	Seal with epoxy seal with epoxy
			2	w < 1.5 mm; L < 0.6 m, only one corner broken	secure broken parts	
			3	w < 1.5 mm; L < 0.6 m, two corners broken	Within 7 days	Full depth repair
			4	w > 1.5 mm; L > 0.6 m or three corners broken	Partial Depth (Refer Figure 8.3 of IRC:SP: 83-2008)	
			5	three or four corners broken	Within 15 days	Reinstate sub-base, and reconstruct the slab as per norms and specifications within

						30days
6	Punchout (Applicable to Continuous Reinforced Concrete Pavement (CRCP) only)	w = width of crack L = length (m/m2)	0	Nil, not discernible	<b>Not Applicable, as it may be full depth</b>	No Action
			1	w < 0.5 mm; L < 3 m/m2		Seal with low viscosity epoxy to secure broken parts.
			2	either w > 0.5 mm or L < 3 m/m2		Within 15 days
			3	w > 1.5 mm and L < 3 m/m2		Full depth repair - Cut out and replace damaged area taking care not to damage Reinforcement.
			4	w > 3 mm, L < 3 m/m2 and deformation		
			5	w > 3 mm, L > 3 m/m2 and deformation		Within 30days
7	Raveling or Honeycomb type surface	r = area damaged surface/total surface of slab (%) h = maximum depth of damage	0	Nil, not discernible	No Action	
			1	r < 2 %	Local repair of areas Damaged	
			2	r = 2 - 10 %	and liable to be damaged.  Within 15 days	
			3	r = 10-25%	Bonded Inlay, 2 or 3 slabs if	
			4	r = 25 - 50 %	Affecting	

					Within 30 days	
			5	r > 50% and h > 25 mm	Reconstruct slabs, 4 or more slabs if affecting.  Within 30 days	
8	Scaling	r = damaged surface/total surface of slab (%) h = maximum depth of damage	0	Nil, not discernible	Short Term  No Action	Long Term
			1	r < 2 %	Local repair of areas Damaged  and liable to be damaged.  Within 7days  Bonded Inlay within 15 Days  Reconstruct slab within 30 days	
			2	r = 2 - 10 %		
			3	r = 10 - 20%		
			4	r = 10 - 30%		
			5	r>30 % and h> 25mm		
9	Polished Surface/Glazing	t = texture depth, sand patch test	0	t > 1 mm	No action	Not Applicable
			1			
			2	t = 1 – 0.6 mm		

			3	$t = 0.6 - 0.3 \text{ mm}$	Monitor rate of deterioration	
			4	$t = 0.3 - 0.1 \text{ mm}$	Diamond Grinding if Affecting	
			5	$t < 0.1 \text{ mm}$	50% or more slabs in a Continuous stretch of minimum 5 km. Within 30 days	
10	Popout (Small Hole), Pothole Refer Para 8.4	n = number/m <sup>2</sup> d = diameter h = maximum depth	0	$d < 50 \text{ mm}; h < 25 \text{ mm}; n < 1 \text{ per } 5 \text{ m}^2$	No action.	Not Applicable
			1	$d = 50 - 100 \text{ mm}; h < 50 \text{ mm}; n < 1 \text{ per } 5 \text{ m}^2$	Partial depth repair 65 mm deep.	
			2	$d = 50 - 100 \text{ mm}; h > 50 \text{ mm}; n < 1 \text{ per } 5 \text{ m}^2$	Within 15 days	
			3	$d = 100 - 300 \text{ mm}; h < 100 \text{ mm}; n < 1 \text{ per } 5 \text{ m}^2$	Partial depth repair 110mm	
			4	$d = 100 - 300 \text{ mm}; h > 100 \text{ mm}; n < 1 \text{ per } 5 \text{ m}^2$	i.e. 10 mm more than the depth of the hole. Within 30 days	
			5	$d > 300 \text{ mm}; h > 100 \text{ mm}; n > 1 \text{ per } 5 \text{ m}^2$	Full depth repair. Within 30 days	

11	Joint Seal Defects	loss or damage L = Length as % total joint length	0	Difficult to discern.	No action.	Not Applicable
			1	Discernible, L < 25% but of little immediate consequence with regard to ingress of water or trapping incompressible material.	Clean joint, inspect later.	
			2	Notable. L > 25% insufficient protection against ingress of water and trapping incompressible material.	Clean and reapply sealant in Selected locations. Within 7 days	
			4	Severe; w > 3 mm negligible protection against ingress of water and trapping incompressible material.	Clean, widen and reseal the joint. Within 7 days	
12	Spalling of Joints	w = width on either side of the joint L = length of spalled portion (as % joint length)	0	Nil, not discernible	No action.	Not Applicable
			1	w < 10 mm	Apply low viscosity epoxy resin/ mortar in cracked portion.	
			2	w = 10 - 20 mm, L < 25%	Within 7 days	
			3	w = 20 - 40 mm, L > 25%	Partial Depth Repair. Within 15 days	

			4	w = 40 - 80 mm, L > 25%	30 - 50 mm deep, h = w + 20% of w, within 30 days	
			5	w > 80 mm, and L > 25%	50 - 100 mm deep repair.  H = w + 20% of w.  Within 30 days	
13	Faulting (or Stepping) in Cracks or Joints	f = difference of level	0	not discernible, < 1 mm	No action.	No action.
			1	f < 3 mm		
			2	f = 3 - 6 mm	Determine cause and observe, take action for diamond grinding	Replace the slab as appropriate.
			3	f = 6 - 12 mm	Diamond Grinding	Within 30days
			4	f= 12 - 18 mm	Raise sunken slab.	Replace the slab as appropriate.
			5	f> 18 mm	Strengthen sub-grade and sub-base by grouting and raising sunken slab	Within 30days

14	Blowup or Buckling	h = vertical displacement from normal profile	0	Nil, not discernible	No Action		
			1	h < 6 mm			
			2	h = 6 - 12 mm			Install Signs to Warn Traffic
			3	h = 12 - 25 mm			
			4	h > 25 mm			Full Depth Repair.
			5	shattered slabs, ie 4 or more pieces			Within 30 days
15	Depression	h = negative vertical displacement from normal profile L =length	0	Not discernible, h < 5 mm	No action.		
			1	h = 5 - 15 mm			
			2	h = 15-30 mm, Nos <20% joints			Install Signs to Warn Traffic
			3	h = 30 - 50 mm			
			4	h > 50 mm or > 20% joints			Strengthen subgrade.



			5	$h > 100 \text{ mm}$	Reinstate pavement at normal level if $L < 20 \text{ m}$ .  Within 30 days	
16	Heave	$h$ = positive vertical displacement from normal profile.  $L$ = length	0	Not discernible. $h < 5 \text{ mm}$	No action.	scrabble
			1	$h = 5 - 15 \text{ mm}$	Follow up.	
			2	$h = 15 - 30 \text{ mm}$ , Nos <20% joints	Install Signs to Warn Traffic	
			3	$h = 30 - 50 \text{ mm}$	within 7 days	
			4	$h > 50 \text{ mm}$ or $> 20\%$ joints	Stabilise subgrade. Reinstate pavement at normal level if length $< 20 \text{ m}$ .	
			5	$h > 100 \text{ mm}$	Within 30 days	
17	Bump	$h$ = vertical displacement from normal profile	0	$h < 4 \text{ mm}$	No action	Construction Limit for New Construction.
			1	$h = 4 - 7 \text{ mm}$	Grind, in case of new construction  within 7 days	

			3	h = 7 - 15 mm	Grind, in case of ongoing Maintenance within 15 days	Replace in case of new construction.  Within 30days
			4	h > 15 mm	Full Depth Repair.  Within 30 days	Full Depth Repair.  Within 30days
18	Lane to Shoulder Dropoff	f = difference of level	0	Nil, not discernible < 3mm	Short Term	Long Term
					No Action	
			1	f = 3 - 10 mm	Spot repair of shoulder  within 7 days	
			2	f = 10 - 25 mm		
			3	f = 25 - 50 mm	Fill up shoulder  within 7 dayss	For any 100 m Stretch Reconstruct shoulder, if affecting 25% or more of stretch.  Within 30days
			4	f = 50 - 75 mm		
			5	f > 75 mm		
Drainage						
19	Pumping	quantity of fines and	0	not discernible	No Action	

		water expelled through open joints and cracks Nos				
			1 to 2	slight/ occasional Nos < 10%	Repair cracks and joints Without delay.	Inspect and repair sub-drainage at distressed sections and upstream.
			3 to 4	appreciable/ Frequent 10 - 25%	Lift or jack slab within 30 days.	
			5	abundant, crack development > 25%	Repair distressed pavement sections. Strengthen subgrade and subbase. Replace slab.  Within 30 days	
20	Ponding	Ponding on slabs due to blockage of drains	0-2	No discernible problem	No action.	
			3 to 4	Blockages observed in drains, but water flowing	Clean drains etc within 7 days, Follow up	Action required to stop water damaging foundation within 30 days.
			5	Ponding, accumulation of water observed	-do	

**Table -3: Maintenance Criteria for Safety Related Items and Other Furniture Items:**

Asset Type	Performance Parameter	Level of Service (LOS)			Frequency of Measurement	Testing Method	Recommended Remedial measures	Time limit for Rectification	Specifications and Standards
Highway	Availability of Safe Sight Distance	As per IRC SP :84-2014, a minimum of safe stopping sight distance shall be available throughout.			Monthly	Manual Measurements with Odometer along with video/ image backup	Removal of obstruction within 24 hours, in case of sight line affected by temporary objects such as trees, temporary encroachments. In case of permanent structure or design deficiency: Removal of obstruction/improvement of deficiency at the earliest Speed Restriction boards and suitable traffic calming measures such as transverse bar marking, blinkers, etc. shall be applied during the period of rectification.		IRC:SP 84-2014
		Design Speed, kmph	Desirable Minimum Sight Distance (m)	Safe Stopping Sight Distance (m)					
		100	360	180					
		80	260	130					
Pavement Marking	Wear	<70% of marking remaining			Bi-Annually	Visual Assessment as per Annexure-F of IRC:35-2015	Re - painting	Cat-1 Defect – within 24 hours Cat-2 Defect - within 2 months	IRC:35-2015
	Day time Visibility	During expected life Service Time Cement Road - 130mcd/m <sup>2</sup> /lux Bituminous Road - 100mcd/m <sup>2</sup> /lux			Monthly	As per Annexure-D of IRC:35-2015	Re - painting	Cat-1 Defect – within 24 hours Cat-2 Defect – within 2 months	IRC:35-2015
	Night Time Visibility	<u>Initial and Minimum Performance for Dry Retro</u>			Bi-Annually	As per Annexure-E	Re - painting	Cat-1 Defect – within 24	IRC:35-2015

		<u>reflectivity during night time:</u>			of IRC:35-2015		hours Cat-2 Defect – within 2 months	
		Design Speed	(RL) Reflectivity (mcd/m <sub>2</sub> /lux)					
		Up to 65	200      80					
		65-100	250      120					
		Above 100	350      150					
		Initial and Minimum Performance for Night Visibility under wet condition (Retro reflectivity):						
Road Signs	Shape and Position	Shape and Position as per IRC:67- 2012. Signboard should be clearly visible for the design speed of the section.		Daily	Visual with video/image backup	Improvement of shape, in case if shape is damaged.  Relocation as Per requirement	48 hours in case of Mandatory Signs, Cautionary and Informatory Signs (Single and Dual post signs) 15 Days in case of Gantry/Cantile ver Sign boards	IRC:67-2012
	Retro reflectivity	As per specifications in IRC:67- 2012		Bi-Annually	Testing of Each signboard using Retro Reflectivity Measuring Device. In accordance	Change of signboard	48 hours in case of Mandatory Signs, Cautionary and Informatory Signs (Single	IRC:67-2012

				with ASTM D 4956-09.		and Dual post signs) 1 Month in case of Gantry/ Cantilever Sign boards	
Kerb	Kerb Height	As per IRC 86:1983 depending upon type of Kerb	Bi-Annually	Use of distance measuring tape	Raising Kerb Height	Within 1 Month	IRC 86:1983
	Kerb Painting	Functionality: Functioning of Kerb painting as intended	Daily	Visual with video/image backup	Kerb Repainting	Within 7-days	IRC 35:2015
Other Road Furniture	Reflective Pavement Markers (Road Studs)	Numbers and Functionality as per specifications in IRC:SP:84-2014 and IRC:35-2015, unless specified in Schedule-B.	Daily	Counting	New Installation	Within 2 months	IRC:SP:84-2014, IRC:35-2015
	Pedestrian Guardrail	Functionality: Functioning of guardrail as intended	Daily	Visual with video/image backup	Rectification	Within 15 days	IRC:SP:84-2014
	Traffic Safety Barriers	Functionality: Functioning of Safety Barriers as intended	Daily	Visual with video/image backup	Rectification	Within 7 days	IRC:SP:84-2014, IRC:119- 2015
	End Treatment of Traffic Safety Barriers	Functionality: Functioning of End Treatment as intended	Daily	Visual with video/image backup	Rectification	Within 7 days	IRC:SP:84-2014, IRC:119- 2015
	Attenuators	Functionality: Functioning of Attenuators as intended	Daily	Visual with video/image backup	Rectification	Within 7 days	IRC:SP-2014, IRC:119- 2015
	Guard Posts and Delineators	Functionality: Functioning of Guard Posts and Delineators as intended	Daily	Visual with video/image backup	Rectification	Within 15 days	IRC: 79 - 1981
	Overhead Sign	Overhead sign structure shall be structurally adequate	Daily	Visual with video/image	Rectification	Within 15 days	IRC:67-2012

	Structure			backup			
	Traffic Blinkers	Functionality: Functioning of Traffic Blinkers as intended	Daily	Visual with video/image backup	Rectification	Within 7 days	IRC:SP:84-2014
Highway Lighting System	Highway Lights	Illumination: Minimum 40 Lux illumination on the road surface	Daily	The illumination level shall be measured with luxmeter	Improvement in Lighting System	24 hours	IRC:SP:84-2014
		No major failure in the lighting system	Daily	-	Rectification of failure	24 hours	IRC:SP:84-2014
		No minor failure in the lighting system	Monthly	-	Rectification of failure	8 hours	IRC:SP:84-2014
	Toll Plaza Canopy Lights	Minimum 40 Lux illumination on the road surface	Daily	The illumination level shall be measured with luxmeter	Improvement in Lighting System	24 hours	IRC:SP:84-2014
		No major/minor failure in the lighting system	Daily	-	Rectification of failure	8 hours	IRC:SP:84-2014
Trees and Plantation including median plantation	Obstruction in a minimum head-room of 5.5 m above carriageway or obstruction in visibility of road signs	No obstruction due to trees	Monthly	Visual with video/image backup	Removal of trees	Immediate	IRC:SP:84-2014
	Deterioration in health of trees and bushes	Health of plantation shall be as per requirement of specifications & instructions issued by Authority from time to time	Daily	Visual with video/image backup	Timely watering and treatment. Or Replacement	Within 90 days	IRC:SP:84-2014

					of Trees and Bushes.		
	Vegetation affecting sight line and road structures	Sight line shall be free from obstruction by vegetation	Daily	Visual with video/image backup	Removal of trees	Immediate	IRC:SP 84-2014
Rest Areas	Cleaning of toilets	-	Daily	-	-	Every 4 hours	
	Defects in electrical, water and sanitary installations	-	Daily	-	Rectification	24 hours	
Other Project Facilities and Approach roads	Damage or deterioration in Approach Roads, pedestrian facilities, truck lay-bys, bus-bays, busshelters, cattle crossings, Traffic Aid Posts, Medical Aid Posts and other works		Daily	-	Rectification	15 days	IRC:SP 84-2014

Asset Type	Performance Parameter	Level of Service (LOS)	Frequency of Measurement	Testing Method	Recommended Remedial measures	Time limit for Rectification	Specifications and Standards
Pipe/box/slab culverts	Free waterway/ unobstructed flow section	85% of culvert normal flow area to available.	2 times in a year (before and after rainy season)	Inspection by Bridge Engineer as per IRC SP: 35-1990 and recording of depth of silting and area of vegetation.	Cleaning silt up soils and debris in culvert barrel after rainy season, removal of bushes and vegetation, U/s of barrel, under barrel and D/s of	15 days before onset of monsoon and within 30 days after end of rainy season.	IRC 5-2015, IRC SP:40-1993 and IRC SP:13-2004



					barrel before rainy season.		
	Leak-proof expansion joints if any	No leakage through expansion joints	Bi-Annually	Physical inspection of expansion joints as per IRC SP: 35-1990 if any, for leakage strains on walls at joints.	Fixing with sealant suitably	30 days or before onset of rains whichever comes earlier	IRC SP:40-1993 and IRC SP:69-2011
	Structurally sound	Spalling of concrete not more than 0.25 sqm	Bi-Annually	Detailed inspection of all components of culvert as per IRC SP:35-1990 and recording the defects	Repairs to spalling, cracking, delamination, rusting shall be followed as per IRC:SP:40-1993.	15 days	IRC SP 40-1993 and MORTH Specification s clause 2800
		Delamination of concrete not more than 0.25 sq.m.					
		Cracks wider than 0.3 mm not more than 1m aggregate length					
	Protection works in good condition	Damaged of rough stone apron or bank revetment not more than 3 sqm, damage to solid apron (concrete apron) not more than 1 sqm	2 times in a year (before and after rainy season)	Condition survey as per IRC SP:35-1990	Repairs to damaged aprons and pitching	30 days after defect observation or 2 weeks before onset of rainy season whichever is earlier.	IRC: SP 40-1993 and IRC:SP:13-2004.
<b>Bridges including ROB's Flyover</b>	Riding quality or user	No pothole in wearing coat on bridge deck	Daily	Visual inspection as per IRC SP:35-	Repairs to BC or wearing coat	15 days	MORTH Specification 2811

<b>etc. as applicable</b>	comfort			1990			
<b>Bridge -Super Structure</b>	Bumps	No bump at expansion joint	Daily	Visual inspection as per IRC SP:35-1990	Repairs to BC on either side of expansion joints, profile correction course on approach slab in case of settlement to approach embankment	15 days	MORT&H Specification 3004.2 & 2811.
	User safety (condition of crash barrier and guard rail)	No damaged or missing stretch of crash barrier or pedestrian hand railing	Daily	Visual inspection and detailed condition survey as per IRC SP: 35-1990.	Repairs and replacement of safety barriers as the case may be	3 days	IRC: 5-1998, IRC SP: 84-2014 and IRC SP: 40-1993.
	Rusted reinforcement	Not more than 0.25 sq.m	Bi- Annually	Detailed condition survey as per IRC SP: 35-1990 using Mobile Bridge Inspection Unit	All the corroded reinforcement shall need to be thoroughly cleaned from rusting and applied with anti-corrosive coating before carrying out the repairs to affected concrete portion with epoxy mortar / concrete.	15 days	IRC SP: 40-1993 and MORTH Specification 1600.
	Spalling of concrete	Not more than 0.50 sq.m					
	Delamination	Not more than 0.50 sq.m					
	Cracks wider than 0.30 mm	Not more than 1m total length	Bi- Annually	Detailed condition survey as per IRC SP: 35-	Grouting with epoxy mortar, investigating causes for cracks	48 Hours	IRC SP: 40-1993 and MORTH Specification

				1990 using Mobile Bridge Inspection Unit	development and carry out necessary rehabilitation		2800.
	Rainwater seepage through deck slab	Leakage - nil	Quarterly	Detailed condition survey as per IRC SP: 35-1990 using Mobile Bridge Inspection Unit	Grouting of deck slab at leakage areas, waterproofing, repairs to drainage spouts	1 months	MORTH specifications 2600 & 2700
	Deflection due to permanent loads and live loads	Within design limits.	Once in every 10 years for spans more than 40 m	Load test method	Carry out major rehabilitation works on bridge to retain original design loads capacity	6 months	IRC SP: 51-1999.
	Vibrations in bridge deck due to moving trucks	Frequency of vibrations shall not be more than 5 Hz	Once in every 5 years for spans more than 30m and every 10 years for spans between 15 to 30 m	Laser displacement sensors or laser vibro-meters	Strengthening of super structure	4 months	AASHTO LRFD specifications
	Leakage in Expansion joints	No damage to elastomeric sealant compound in strip seal expansion joint, no leakage of rain water through expansion joint in case of buried and asphalt plug	Bi-Annually	Detailed condition survey as per IRC SP:35-1990 using Mobile Bridge Inspection Unit	Replace of seal in expansion joint	15 days	MORTH specifications 2600 and IRC SP: 40-1993.

		and copper strip joint					
	Debris and dust in strip seal expansion joint	No dust or debris in expansion joint gap.	Monthly	Detailed condition survey as per IRC SP:35-1990 using Mobile Bridge Inspection Unit	Cleaning of expansion joint gaps thoroughly	3 days	MORTH specifications 2600 and IRC SP: 40-1993.
	Drainage spouts	No down take pipe missing/broken below soffit of the deck slab. No silt, debris, clogging of drainage spout collection chamber.	Bi-Annually	Detailed condition survey as per IRC SP: 35-1990 using Mobile Bridge Inspection Unit	Cleaning of drainage spouts thoroughly. Replacement of missing/broken down take pipes with a minimum pipe extension of 500mm below soffit of slab. Providing sealant around the drainage spout if any leakages observed	3 days	MORTH specification 2700.
<b>Bridge-substructure</b>	Cracks/ spalling of concrete/ Rusted steel	No cracks, spalling of concrete and rusted steel	Bi-Annually	Detailed condition survey as per IRC SP: 35-1990 using Mobile Bridge Inspection Unit	All the corroded reinforcement shall need to be thoroughly cleaned from rusting and applied with anti-corrosive coating before carrying out repairs to substructure by grouting/guniting	30 days	IRC SP: 40-1993 and MORTH specification 2800.

					and micro concreting depending on type of defect noticed		
	Bearings	Delaminating of bearing reinforcement not more than 5%, cracking or tearing of rubber not more than 2 locations per side, no rupture of reinforcement or rubber	Bi-Annually	Detailed condition survey as per IRC SP: 35- 1990 using Mobile Bridge Inspection Unit	In case of failure of even one bearing on any pier/abutment, all the bearings on that pier/ abutment shall be replaced, in order to get uniform load transfer on to bearings.	3 months	MORTH specificatio n 2810 and IRC SP: 40- 199.
<b>Bridge Foundations</b>	Scouring around foundations	Scouring shall not be lower than maximum scour level for the bridge	Bi-Annually	Condition survey and visual Inspection as per IRC SP:35- 1990 using Mobile Bridge Inspection Unit. In case of oubt, use Underwater camera for inspection of deep wells in major Rivers.	suitable protection works around pier/abutment	1 months	IRC SP: 40- 1993, IRC 83-2014, MORTH specification 2500
	Protection works in good	Damaged of rough stone	2 times in a year (before	Condition survey as per	Repairs to damaged	30 days After defect	IRC: SP 40- 1993 and

	condition	apron or bank revetment not more than 3 sq.m, damage to solid apron (concrete apron) not more than 1 sq.m	and after rainy season)	IRC SP:35- 1990	aprons and pitching.	observation or 2 weeks before onset of rainy season whichever is earlier.	IRC:SP:13- 2004.
<p><b>Note:</b> Any Structure during the entire contract period which is found that does not complies with all requirements of this Table will be prepared, rehabilitated or even reconstructed under the scope of the contractor.</p>							

**Table 4:** Maintenance Criteria for Structures and Culverts:**Table 5: Maintenance Criteria for Hill Roads**

In addition to above, for hill roads the following provisions for maintenance is also to done.

<b>Hill Roads</b>		
(i)	Damage to Retaining wall/ Breast wall	7 (Seven) days
(ii)	Landslides requiring clearance	12 (Twelve) hours
(iii)	Snow requiring clearance	24 (Twenty Four) hours

**Note:** For all tables 1 to 5 above, latest BIS & IRC standards (even those not indicated herewith) along with MoRTH specifications shall be binding for all maintenance activities.

#### **A. Flexible Pavement**

<b>Nature of Defect or deficiency</b>		<b>Time limit for repair/rectification</b>
<b>(b) Granular earth shoulders, side slopes, drains and culverts</b>		
(i)	Variation by more than 1 % in the prescribed slope of camber/cross fall (shall not be less than the camber on the main carriageway)	7 (seven) days
(ii)	Edge drop at shoulders exceeding 40 mm	7 (seven) days
(iii)	Variation by more than 15% in the prescribed side (embankment) slopes	30 (thirty) days
(iv)	Rain cuts/gullies in slope	7 (seven) days
(v)	Damage to or silting of culverts and side drains	7 (seven) days
(vi)	Desilting of drains in urban/semi- urban areas	24 (twenty four) hours
(vii)	Railing, parapets, crash barriers	7 (seven) days (Restore immediately if causing safety hazard)
<b>(c) Road side furniture including road sign and pavement marking</b>		
(i)	Damage to shape or position, poor visibility or loss of retro- reflectivity	48 (forty eight) hours
(ii)	Painting of km stone, railing, parapets, crash barriers	As and when required/ Once every year
(iii)	Damaged/missing signs road requiring replacement	7 (seven) days
(vi)	Damage to road mark ups	7 (seven) days
<b>(d) Road lighting</b>		
(i)	Any major failure of the system	24 (twenty four) hours
(ii)	Faults and minor failures	8 (eight) hours
<b>(e) Trees and plantation</b>		
(i)	Obstruction in a minimum head- room of 5 m above carriageway or obstruction in visibility of road signs	24 (twenty four) hours
(ii)	Removal of fallen trees from carriageway	4 (four) hours
(iii)	Deterioration in health of trees and bushes	Timely watering and treatment
(vi)	Trees and bushes requiring replacement	30 (thirty) days
(v)	Removal of vegetation affecting sight line and road structures	15 (fifteen) days
<b>(f) Rest area</b>		
(i)	Cleaning of toilets	Every 4 (four) hours

(ii)	Defects in electrical, water and sanitary installations	24 (twenty four) hours
<b>(g) [Toll Plaza]</b>		
<b>(h)</b>	<b>Other Project Facilities and Approach roads</b>	
(i)	Damage in approach roads, pedestrian facilities, truck lay- byes, bus-bays, bus-shelters, cattle crossings, [Traffic Aid Posts, Medical Aid Posts] and service roads	15 (fifteen) days
(ii)	Damaged vehicles or debris on the road	4 (four) hours
(iii)	Malfunctioning of the mobile crane	4 (four) hours
<b>Bridges</b>		
<b>(a) Superstructure</b>		
(i)	Any damage, cracks, spalling/ scaling Temporary measures Permanent measures	within 48 (forty eight) hours within 15 (fifteen) days or as specified by the Authority's Engineer
<b>(b) Foundations</b>		
(i)	Scouring and/or cavitation	15 (fifteen) days
<b>(c) Piers, abutments, return walls and wing walls</b>		
(i)	Cracks and damages including settlement and tilting, spalling, scaling	30 (thirty) days
<b>(d) Bearings (metallic) of bridges</b>		
(i)	Deformation, damages, tilting or shifting of bearings	15 (fifteen) days Greasing of metallic bearings once in a year
<b>(e) Joints</b>		
(i)	Malfunctioning of joints	15 (fifteen) days
<b>(f) Other items</b>		
(i)	Deforming of pads in elastomeric bearings	7 (seven) days
(ii)	Gathering of dirt in bearings and joints; or clogging of spouts, weep holes and vent-holes	3 (three) days
(iii)	Damage or deterioration in kerbs, parapets, handrails and crash barriers	3 (three) days (immediately within 24 hours if posing danger to safety)
(vi)	Rain-cuts or erosion of banks of the side slopes of approaches	7 (seven) days
(v)	Damage to wearing coat	15 (fifteen) days
(vi)	Damage or deterioration in approach slabs, pitching, apron, toes, floor or guide bunds	30 (thirty) days
(vii)	Growth of vegetation affecting the structure or obstructing the waterway	15 (fifteen) days
<b>(g) Hill Roads</b>		
(i)	Damage to retaining wall/breast wall	7 (seven) days
(ii)	Landslides requiring clearance	12 (twelve) hours
(iii)	Snow requiring clearance	24 (twenty four) hours
<b>[Note: Where necessary, the Authority may modify the time limit for repair/rectification, or add to the nature of Defect or deficiency before issuing the bidding document, with the approval of the competent authority.]</b>		



## Schedule - F

(See Clause 4.1 (vii)(a))

### Applicable Permits

#### 1. Applicable Permits

##### 1.1 The Contractor shall obtain, as required under the Applicable Laws, the following Applicable Permits:

- (a) Permission of the State Government for extraction of boulders from quarry;
- (b) Permission of Village Panchayats and Pollution Control Board for installation of crushers;
- (c) Licence for use of explosives;
- (d) Permission of the State Government for drawing water from river/reservoir;
- (e) Licence from inspector of factories or other competent Authority for setting up batching plant;
- (f) Clearance of Pollution Control Board for setting up batching plant;
- (g) Clearance of Village Panchayats and Pollution Control Board for setting up asphalt plant;
- (h) Permission of Village Panchayats and State Government for borrow earth; and
- (i) Any other permits or clearances required under Applicable Laws.

##### 1.2 Applicable Permits, as required, relating to environmental protection and conservation shall have been procured by the Authority in accordance with the provisions of this Agreement.

Schedule – G  
(See Clauses 7.1 and 19.2)  
Annex-I  
(See Clause 7.1)

Form of Bank Guarantee  
[Performance Security/Additional Performance Security]

Managing Director  
National Highways and Infrastructure Development Corporation Ltd, New Delhi

WHEREAS:

- (A) \_\_\_\_\_ [name and address of contractor] (hereinafter called the “Contractor”) and National Highways and Infrastructure Development Corporation Ltd, 3rd Floor, PTI Building, 4, Parliament Street, New Delhi – 110001, (hereinafter called the “Authority”) have entered into an agreement (hereinafter called the “Agreement”) for the work **“Rehabilitation and up-gradation of road from km 46.597 to km 66.845 (Total length: 20.248 km) of Kanchanpur-Vaghmun section on NH-44A to two lane with paved shoulder in the state of Tripura on EPC basis- (package-III)” on Engineering, Procurement and Construction (the “EPC”) basis**, subject to and in accordance with the provisions of the Agreement.
- (B) The Agreement requires the Contractor to furnish a Performance Security for due and faithful performance of its obligations, under and in accordance with the Agreement, during the {Construction Period/ Defects Liability Period and Maintenance Period} (as defined in the Agreement) in a sum of Rs..... cr. (Rupees ..... crore) (the “Guarantee Amount”).
- (C) We, ..... through our branch at ..... (the “Bank”) have agreed to furnish this bank guarantee (hereinafter called the “Guarantee”) by way of Performance Security.

NOW, THEREFORE, the Bank hereby, unconditionally and irrevocably, guarantees and affirms as follows:

1. The Bank hereby unconditionally and irrevocably guarantees the due and faithful performance of the Contractor’s obligations during the {Construction Period/ Defects Liability Period and Maintenance Period} under and in accordance with the Agreement, and agrees and undertakes to pay to the Authority, upon its mere first written demand, and without any demur, reservation, recourse, contest or protest, and without any reference to the Contractor, such sum or sums up to an aggregate sum of the Guarantee Amount as the Authority shall claim, without the Authority being required to prove or to show grounds or reasons for its demand and/or for the sum specified therein.
2. A letter from the Authority, under the hand of an officer not below the rank of General Manager in the NHIDCL, that the Contractor has committed default in the due and faithful performance of all or any of its obligations under and in accordance with the Agreement shall be conclusive, final and binding on the Bank. The Bank further agrees that the Authority shall be the sole judge as to whether the Contractor is in default in due and faithful performance of its obligations during and under the Agreement and its decision that the Contractor is in default shall be final and binding on the Bank, notwithstanding any differences between the Authority and the Contractor, or any dispute between them pending before any court, tribunal, arbitrators or any other authority or body, or by the discharge of the Contractor for any reason

whatsoever.

3. In order to give effect to this Guarantee, the Authority shall be entitled to act as if the Bank were the principal debtor and any change in the constitution of the Contractor and/or the Bank, whether by their absorption with any other body or corporation or otherwise, shall not in any way or manner affect the liability or obligation of the Bank under this Guarantee.

4. It shall not be necessary, and the Bank hereby waives any necessity, for the Authority to proceed against the Contractor before presenting to the Bank its demand under this Guarantee.

5. The Authority shall have the liberty, without affecting in any manner the liability of the Bank under this Guarantee, to vary at any time, the terms and conditions of the Agreement or to extend the time or period for the compliance with, fulfillment and/ or performance of all or any of the obligations of the Contractor contained in the Agreement or to postpone for any time, and from time to time, any of the rights and powers exercisable by the Authority against the Contractor, and either to enforce or forbear from enforcing any of the terms and conditions contained in the Agreement and/or the securities available to the Authority, and the Bank shall not be released from its liability and obligation under these presents by any exercise by the Authority of the liberty with reference to the matters aforesaid or by reason of time being given to the Contractor or any other forbearance, indulgence, act or omission on the part of the Authority or of any other matter or thing whatsoever which under any law relating to sureties and guarantors would but for this provision have the effect of releasing the Bank from its liability and obligation under this Guarantee and the Bank hereby waives all of its rights under any such law.

6. This Guarantee is in addition to and not in substitution of any other guarantee or security now or which may hereafter be held by the Authority in respect of or relating to the Agreement or for the fulfillment, compliance and/or performance of all or any of the obligations of the Contractor under the Agreement.

7. Notwithstanding anything contained hereinbefore, the liability of the Bank under this Guarantee is restricted to the Guarantee Amount and this Guarantee will remain in force for the period specified in paragraph 8 below and unless a demand or claim in writing is made by the Authority on the Bank under this Guarantee all rights of the Authority under this Guarantee shall be forfeited and the Bank shall be relieved from its liabilities hereunder.

8. The Guarantee shall cease to be in force and effect on \*\*\*\*\$. Unless a demand or claim under this Guarantee is made in writing before expiry of the Guarantee, the Bank shall be discharged from its liabilities hereunder.

9. The Bank undertakes not to revoke this Guarantee during its currency, except with the previous express consent of the Authority in writing, and declares and warrants that it has the power to issue this Guarantee and the undersigned has full powers to do so on behalf of the Bank.

10. Any notice by way of request, demand or otherwise hereunder may be sent by post addressed to the Bank at its above referred branch, which shall be deemed to have been duly authorised to receive such notice and to effect payment thereof forthwith, and if sent by post it shall be deemed to have been given at the time when it ought to have been delivered in due course of post and in proving such notice, when given by post, it shall be sufficient to prove that the envelope containing the notice was posted and a certificate signed by an officer of the Authority that the envelope was so posted shall be conclusive.

11. This Guarantee shall come into force with immediate effect and shall remain in force and effect for up to the date specified in paragraph 8 above or until it is released earlier by the Authority

pursuant to the provisions of the Agreement.

12. This guarantee shall also be operatable at our..... Branch at New Delhi, from whom, confirmation regarding the issue of this guarantee or extension / renewal thereof shall be made available on demand. In the contingency of this guarantee being invoked and payment thereunder claimed, the said branch shall accept such invocation letter and make payment of amounts so demanded under the said invocation.

13. Intimation regarding issuance of this Bank Guarantee shall be sent to Authority's Bank through SFMS gateway as per the details below:

S.No.	Particulars	Details
1	Name of Beneficiary	National Highways & Infrastructure Development Corporation Limited
2	Beneficiary Bank Account No.	90621010002659
3	Beneficiary Bank Branch	IFSC SYNB0009062
4	Beneficiary Bank Branch Name	Transport Bhawan, New Delhi
5	Beneficiary Bank Address	Syndicate Bank transport Bhawan, 1st Parliament Street, New Delhi-110001

Signed and sealed this ..... day of ....., 20..... at ..... SIGNED,  
SEALED AND DELIVERED

For and on behalf of the Bank by:  
(Signature)

(Name) (Designation)

(Code Number) (Address)

NOTES:

(i) The bank guarantee should contain the name, designation and code number of the officer(s) signing the guarantee.

(ii) The address, telephone number and other details of the head office of the Bank as well as of issuing branch should be mentioned on the covering letter of issuing branch.

(iii) The issuance of the Bank Guarantee shall be intimated by the banker of the Bidder through SFMS Gateway to NHIDCL's Bank Account in Syndicate Bank, Transport Bhawan Branch, New Delhi and BG confirmation shall be obtained from Syndicate Bank before acceptance of the Bank Guarantee.

Annex – II  
(Schedule - G)  
(See Clause 19.2)  
Form for Guarantee for Advance Payment

Managing Director  
National Highways and Infrastructure Development Corporation Ltd, New Delhi

WHEREAS:

- (A) [name and address of contractor name and address of contractor] (hereinafter called the “Contractor”) and National Highways and Infrastructure Development Corporation Ltd, 3rd Floor, PTI Building, 4, Parliament Street, New Delhi – 110001, (hereinafter called the “Authority”) have entered into an agreement (hereinafter called the “Agreement”) for the work **“Rehabilitation and up-gradation of road from km 46.597 to km 66.845 (Total length: 20.248 km) of Kanchanpur- Vagmun section on NH-44A to two lane with paved shoulder in the state of Tripura on EPC basis- (package-III)” on Engineering, Procurement and Construction (the “EPC”) basis**, subject to and in accordance with the provisions of the Agreement
- (B) In accordance with Clause 19.2 of the Agreement, the Authority shall make to the Contractor an interest bearing @Bank Rate + 3% advance payment (herein after called “Advance Payment”) equal to 10% (ten per cent) of the Contract Price; and that the Advance Payment shall be made in two installments subject to the Contractor furnishing an irrevocable and unconditional guarantee by a scheduled bank for an amount equivalent to 110% (one hundred and ten percent) of such installment to remain effective till the complete and full repayment of the installment of the Advance Payment as security for compliance with its obligations in accordance with the Agreement. The amount of {first/second} installment of the Advance Payment is Rs. ----- cr. (Rupees ----- crore) and the amount of this Guarantee is Rs. ----- cr. (Rupees ----- crore) (the “Guarantee Amount”)<sup>\$</sup>.
- (C) We, ..... through our branch at ..... (the “Bank”) have agreed to furnish this bank guarantee (hereinafter called the “Guarantee”) for the Guarantee Amount.

NOW, THEREFORE, the Bank hereby, unconditionally and irrevocably, guarantees and affirms as follows:

1. The Bank hereby unconditionally and irrevocably guarantees the due and faithful repayment on time of the aforesaid instalment of the Advance Payment under and in accordance with the Agreement, and agrees and undertakes to pay to the Authority, upon its mere first written demand, and without any demur, reservation, recourse, contest or protest, and without any reference to the Contractor, such sum or sums up to an aggregate sum of the Guarantee Amount as the Authority shall claim, without the Authority being required to prove or to show grounds or reasons for its demand and/or for the sum specified therein.

---

<sup>\$</sup> The Guarantee Amount should be equivalent to 110% of the value of the applicable instalment.

A letter from the Authority, under the hand of an officer not below the rank of General

Manager in the NHIDCL, that the Contractor has committed default in the due and faithful performance of all or any of its obligations for the repayment of the instalment of the Advance Payment under and in accordance with the Agreement shall be conclusive, final and binding on the Bank. The Bank further agrees that the Authority shall be the sole judge as to whether the Contractor is in default in due and faithful performance of its obligations during and under the Agreement and its decision that the Contractor is in default shall be final and binding on the Bank, notwithstanding any differences between the Authority and the Contractor, or any dispute between them pending before any court, tribunal, arbitrators or any other authority or body, or by the discharge of the Contractor for any reason whatsoever.

2. In order to give effect to this Guarantee, the Authority shall be entitled to act as if the Bank were the principal debtor and any change in the constitution of the Contractor and/or the Bank, whether by their absorption with any other body or corporation or otherwise, shall not in any way or manner affect the liability or obligation of the Bank under this Guarantee.
3. It shall not be necessary, and the Bank hereby waives any necessity, for the Authority to proceed against the Contractor before presenting to the Bank its demand under this Guarantee.
4. The Authority shall have the liberty, without affecting in any manner the liability of the Bank under this Guarantee, to vary at any time, the terms and conditions of the Advance Payment or to extend the time or period of its repayment or to postpone for any time, and from time to time, any of the rights and powers exercisable by the Authority against the Contractor, and either to enforce or forbear from enforcing any of the terms and conditions contained in the Agreement and/or the securities available to the Authority, and the Bank shall not be released from its liability and obligation under these presents by any exercise by the Authority of the liberty with reference to the matters aforesaid or by reason of time being given to the Contractor or any other forbearance, indulgence, act or omission on the part of the Authority or of any other matter or thing whatsoever which under any law relating to sureties and guarantors would but for this provision have the effect of releasing the Bank from its liability and obligation under this Guarantee and the Bank hereby waives all of its rights under any such law.
5. This Guarantee is in addition to and not in substitution of any other guarantee or security now or which may hereafter be held by the Authority in respect of or relating to the Advance Payment.
6. Notwithstanding anything contained hereinbefore, the liability of the Bank under this Guarantee is restricted to the Guarantee Amount and this Guarantee will remain in force for the period specified in paragraph 8 below and unless a demand or claim in writing is made by the Authority on the Bank under this Guarantee all rights of the Authority under this Guarantee shall be forfeited and the Bank shall be relieved from its liabilities hereunder.
7. The Guarantee shall cease to be in force and effect on \*\*\*, \$ Unless a demand or claim under this Guarantee is made in writing on or before the aforesaid date, the Bank shall be discharged from its liabilities hereunder.
8. The Bank undertakes not to revoke this Guarantee during its currency, except with the

previous express consent of the Authority in writing, and declares and warrants that it has the power to issue this Guarantee and the undersigned has full powers to do so on behalf of the Bank.

9. Any notice by way of request, demand or otherwise hereunder may be sent by post addressed to the Bank at its above referred branch, which shall be deemed to have been duly authorised to receive such notice and to effect payment thereof forthwith, and if sent by post it shall be deemed to have been given at the time when it ought to have been delivered in due course of post and in proving such notice, when given by post, it shall be sufficient to prove that the envelope containing the notice was posted and a certificate signed by an officer of the Authority that the envelope was so posted shall be conclusive.
10. This Guarantee shall come into force with immediate effect and shall remain in force and effect up to the date specified in paragraph 8 above or until it is released earlier by the Authority pursuant to the provisions of the Agreement.
11. This guarantee shall also be operatable at our..... Branch at New Delhi, from whom, confirmation regarding the issue of this guarantee or extension / renewal thereof shall be made available on demand. In the contingency of this guarantee being invoked and payment thereunder claimed, the said branch shall accept such invocation letter and make payment of amounts so demanded under the said invocation.
12. Intimation regarding issuance of this Bank Guarantee shall be sent to Authority's Bank through SFMS gateway as per the details below:

S.No.	Particulars	Details
1	Name of Beneficiary	National Highways & Infrastructure Development Corporation Limited
2	Beneficiary Bank Account No.	90621010002659
3	Beneficiary Bank Branch	IFSC SYNB0009062
4	Beneficiary Bank Branch Name	Transport Bhawan, New Delhi
5	Beneficiary Bank Address	Syndicate Bank transport Bhawan, 1st Parliament Street, New Delhi-110001

Signed and sealed this ..... day of ....., 20..... at .....  
SIGNED, SEALED AND DELIVERED

For and on behalf of the Bank by:  
(Signature)

(Name) (Designation)

(Code Number)

(Address) NOTES:

- (i) The bank guarantee should contain the name, designation and code number of the officer(s) signing the guarantee.
- (ii) The address, telephone number and other details of the head office of the Bank as well as of issuing branch should be mentioned on the covering letter of issuing branch.
- (iii) The issuance of the Bank Guarantee shall be intimated by the banker of the Bidder through SFMS Gateway to NHIDCL's Bank Account in Syndicate Bank, Transport Bhawan Branch, New Delhi and BG confirmation shall be obtained from Syndicate Bank before acceptance of the Bank Guarantee.



## Schedule - H

(See Clauses 10.1 (iv) and 19.3)

## Contract Price Weightages

1. The Contract Price for this Agreement is Rs. \*\*\*\*\*
- 1.2 Proportions of the Contract Price for different stages of Construction of the Project Highway shall be as specified below:

1.2 Proportions of the Contract Price for different stages of Construction of the Project Highway shall be as specified below:

<b>Item</b>	<b>Weightage in percentage to the Contract Price</b>	<b>Stage for Payment</b>	<b>Percentage weightage</b>
<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>
Road works including culverts, widening and repair of culverts.	[60.54%]	<b>A- Widening and strengthening of existing road</b>  (1)Earthwork up to top of the sub-grade (2) sub-base Course (3) Non Bituminous base Course (4) Bituminous Base Course (5) Wearing coat (6) Widening and repair of culvert  <b>B.1- Reconstruction New 2-lane realignment/bypass (Flexible pavement)</b> (1) Earthwork up to top of the sub-grade (2) sub-base Course (3) Non Bituminous base Course (4) Bituminous Base Course (5) Wearing coat  <b>B.2- Reconstruction/ New 2-lane realignment/bypass (Rigid pavement)</b> (1)Earthwork up to top of the sub-grade (2) sub-base Course (3)Dry lean concrete (DLC) Course (4) Pavement quality control (PQC) course  <b>C.1- Reconstruction/ New Service Road (Flexible pavement)</b> (1) Earthwork up to top of the sub-grade (2) <u>sub-base Course</u> (3) <u>Non Bituminous base Course</u> (4) <u>Bituminous Base Course</u> (5) <u>Wearing coat</u>  <b>C.2-Reconstruction/ New Service Road (Rigid pavement)</b> (1) Earthwork up to top of the sub-grade (2) <u>sub-base Course</u> (3) <u>Dry lean concrete (DLC) Course</u> (4) Pavement quality control (PQC) course  <b>D-Re-construction/ New culverts on existing road, realignments, bypasses:</b> Culvert (Length<6m)	[15.50%] [11.29%] [0%] [32.98%] [9.88%] [0%]  [0%] [0%] [0%] [0%] [0%]  [0%] [0%] [0%] [0%]  [0%] [0%] [0%] [0%]  [0%] [0%] [0%] [0%]
			[30.35%]

Minor Bridge/ Underpasses/Overpasses	0%	<p><b>A.1- Widening and repairs of Minor Bridges (length&gt;6m and &lt;60m)</b></p> <p>Minor bridges [0%]</p> <p><b>A.2 New Minor Bridges (length&gt;6m and &lt;60m)</b></p> <p><b>(1) Foundation</b></p> <p>+<b>Sub-Structure:</b> On completion of the foundation work including foundations for wing and return walls, abutments, piers upto the abutment/pier cap. [0%]</p> <p><b>(2)Super Structure:</b> On completion of the super-structure in all respects including Girder, Deck slab, bearings [0%]</p> <p><b>(3)Approaches:</b> On completion of approaches including Retaining walls, stone pitching, protection works complete in all respect, tests on completion in all respect and fit for use [0%]</p> <p><b>(4)Guide Bunds and River Training Works:</b></p> <p>On completion of Guide Bunds and River Training Works complete in all respect. [0%]</p> <p><b>B-1 Widening and repair of underpasses/ overpasses</b></p> <p>Underpasses/ Overpasses</p> <p><b>B-2 New underpasses/ overpasses</b></p> <p><b>(1) Foundation +Substructure:</b> On completion of the foundation work including foundation for wing and return wall, abutments, piers upto the abutment/pier cap. [0%]</p> <p><b>(2)Super Structure:</b> On completion of the super-structure in all respects including wearing coat, bearings, expansion joints, hand rails, crash barriers, road signs &amp; markings, tests on completion etc. complete in all respect. [0%]</p> <p>Wearing Coat (a) in case of Over pass wearing coat including expansion joints complete in all respects as specified and (b) in case of underpass- rigid pavement including drainage facility complete in all respects as specified.</p> <p><b>(3) Approaches:</b> On completion of approaches including Retaining walls/ Reinforced Earth walls, stone pitching, protection works complete in all respect and fit for use. [0%]</p>	
---	----	---	--

Major Bridges (length>60m) work and ROB/RUB/elevated section/ flyover including viaducts, if any	0%	<p><b>A-1 Widening and repair of Major Bridges</b></p> <p>(1) Foundation [0%]  (2) Sub-structure [0%]  (3) Super-structure including bearings. [0%]  (4) wearing coat including expansion joints [0%]  (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%]  (6)Wing walls/return walls up to top [0%]  (7) Guide bunds, river Training works etc. [0%]  (8)Approaches (including Retaining walls, stone pitching and protection works) [0%]</p> <p><b>A.2New Major Bridges</b></p> <p>(1) Foundation [0%]  (2) Sub-structure [0%]  (3) Super-structure including bearings. [0%]  (4) wearing coat including expansion joints [0%]  (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%]  (6)Wing walls/return walls [0%]  (7) Guide bunds, river Training works etc. [0%]  (8)Approaches (including Retaining walls, stone pitching and protection works) [0%]</p> <p><b>B.1- Widening and repair of</b></p> <p><b>(a) ROB</b></p> <p><b>(b) RUB</b></p> <p>(1) Foundation [0%]  (2) Sub-structure [0%]  (3) Super-structure (including bearings) [0%]  <b>(4) wearing coat: (a)</b> in case of ROB- wearing coat including expansion joints complete in all respects as specified and (b) in case of RUB- rigid pavement under RUB including drainage facility complete in all respects as specified and specified.  (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%]  (6)Wing walls/return walls [0%]  (7)Approaches (including Retaining walls stone pitching and protection works) [0%]</p> <p><b>B.2- New ROB/ RUB</b></p> <p><b>(a) ROB</b></p> <p><b>(b) RUB</b></p> <p>(1) Foundation [0%]  (2) Sub-structure [0%]  (3) Super-structure (including bearings) [0%]  <b>(4) wearing coat: (a)</b> in case of ROB- wearing coat including expansion joints complete in all respects as specified and (b) in case of RUB- rigid pavement under RUB including drainage facility complete in all respects as specified and specified.  (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%]  (6)Wing walls/return walls [0%]  (7)Approaches (including Retaining walls/Reinforced Earth wall, stone pitching and protection works) [0%]</p>	
--	----	--	--

		<b>C.1- Widening and repair of Elevated Section/Flyovers/Grade separators</b> 1) Foundation [0%] (2) Sub-structure [0%] (3) Super-structure (including bearings) [0%] (4) wearing coat including expansion joints [0%] (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%] (6)Wing walls/return walls [0%] (7)Approaches (including Retaining walls/Reinforced Earth wall, stone pitching and protection works) [0%]  <b>C.2- New Elevated Section/Flyovers/Grade separators</b> 1) Foundation [0%] (2) Sub-structure [0%] (3) Super-structure (including bearings) [0%] (4) wearing coat including expansion joints [0%] (5) Miscellaneous Items like hand rails, crash barriers, road markings etc.) [0%] (6)Wing walls/return walls [0%] (7)Approaches (including Retaining walls/Reinforced Earth wall, stone pitching and protection works) [0%]	
Other works	39.46%	(i) Toll Plaza [0%] (ii) Road side drains [11.18%] (iii) Road signs, marking, km stones, safety devices,... [5.78%] (iv) Project facilities (a) Bus Bays [1.54%] (b) Truck lay byes [0%] (c) Rest Areas [0%] (d) Others [0%] (v) Road side plantation [0%] (vi) Repair of protection works other than approaches to the bridges, elevated sections/ flyovers/grade separators and ROBs/RUBs. [0%] (vii) Safety and traffic management during construction [0.01%] (viii) Site Clearance [0.30%] (ix) Retaining Wall [81.19%]	

### ***Procedure of estimating the value of work done***

#### **(i) Road works**

Procedure for estimating the value of road work done shall be as follows:

Table 1.3.1

Stage of Payment	Percentage -weightage	Payment Procedure
<b>A-Widening and strengthening of road</b>		
(1) Earthwork up to top of the sub-grade	15.50 %	Unit of measurement is linear length. Payment of each stage shall be made on pro rata basis on completion of a stage in a length of not less than 10 (ten) percent of the total length.
(2) sub-base Course	11.29 %	

(3) Non Bituminous Base course	0 %	
(4) Bituminous Base course	32.98 %	
(5) Wearing Coat	9.88 %	
(6) Widening and repair of culverts	0%	Cost of ten completed culverts shall be determined on pro rata with respect to the total number of culverts. The Payment shall be made on the completion of atleast one culverts.
<b>B.1Reconstruction/ New 2-lane realignment, bypass (flexible pavement)</b>		Unit of measurement is linear length. Payment of each stage shall be made on pro rata basis on completion of a stage in full length or 0.5 (Zero point five) km length, Whichever is less.
(1) Earthwork up to top of the sub-grade	0%	
(2) Earthwork in shoulders	0%	
(3) sub-base Course	0%	
(4) Non Bituminous Base course	0%	
(5) Bituminous Base course	0%	
(6) Wearing Coat	0%	
<b>B.2Reconstruction/ New 2-lane realignment, bypass (Rigid pavement)</b>	0 %	Unit of measurement is linear length. Payment of each stage shall be made on pro rata basis on completion of a stage in full length or 0.5 (Zero point five) km length, Whichever is less.
(1)Earthwork up to top of the sub-grade		
(2) <u>sub-base Course</u>	0 %	
(3)Dry lean concrete (DLC) Course	0 %	
(4) Pavement quality control (PQC) course	0 %	
<b>C.1-Reconstruction/ New Service Road (flexible pavement)</b>	0 %	Unit of measurement is linear length. Payment of each stage shall be made on pro rata basis on completion of a stage in full length or 0.5 (zero point five) km length, Whichever is less.
(1) Earthwork up to top of the sub-grade		
(2) sub-base Course	0%	
(3) Non Bituminous Base course	0%	
(4) Bituminous Base course	0%	
(5) Wearing Coat	0%	
<b>C.2Reconstruction/ New Service Road (Rigid pavement)</b>	0%	Unit of measurement is linear length. Payment of each stage shall be made on pro rata basis on completion of a stage in full length or 0.5 (zero point five) km length, Whichever is less.
(1)Earthwork up to top of the sub-grade		
(2) <u>sub-base Course</u>	0%	
(3)Dry lean concrete (DLC) Course	0 %	

(4) Pavement quality control (PQC) course	0 %	
<b>D. Re-construction and new culverts on existing road, realignments, bypasses:</b>  (1) Culvert (length<6m)	30.35 %	Cost of each culvert shall be determined on pro rata basis with respect to the total number of culverts. Payment shall be made on the completion of five culverts.

@. For example, if the total length of bituminous work to be done is 100 km, the cost per km of bituminous work shall be determined as follows:

$$\text{Cost per km} = P \times \text{weightage for road work} \times \text{weightage for bituminous work} \times (1/L)$$

Where P= Contract Price

L = Total length in km

Similarly, the rates per km for stages shall be worked out accordingly.

**Note: The length affected due to law and order problems or litigation during execution due to which the contractor is unable to execute the work, may be deducted from the total project length for payment purposes. The total length calculated here is only for payment purposes and will not be affected and referred in other clauses of the contract Agreement.**

(ii) Minor Bridge and underpasses/Overpasses.

Procedure for estimating the value of minor Bridge and underpasses/Overpasses shall be as stated in table 1.3.2:

Table 1.3.2

Stage of Payment	Weightage	Payment Procedure
<b>A- Widening and repairs of minor bridges</b>  (length>6m and < 60m)	0%	Cost of each minor Bridge shall be determined on pro rata basis with respect to the total linear length of the minor Bridges. Payment shall be made on completion of widening & repair works of a minor Bridge.
<b>A.2-New Minor bridges</b> (length>6m and < 60m)  (1) <b>Foundation +Sub-Structure:</b> On completion of the foundation work including foundations for wing and return walls, abutments, piers up to the abutment/pier cap.	0%	(i) Foundation +Sub- Structure: Cost of each minor bridge shall be determined on pro rata basis with respect to the total linear length (m) of the minor bridges. Payment against foundation + sub-structure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of foundation + substructure of each bridge subject to completion of at least two foundations along with sub-structure up to abutment/pier cap level of each bridge.  In case where load testing is required for foundation, the trigger of first payment shall

		include load testing also where specified.
<b>(2) Super-structure:</b> On completion of the superstructure in all respects including wearing coat, bearings, expansion joints, hand rails, crash barriers, road signs & markings, tests on completion etc. complete in all respect.	0%	<b>Super-structure:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure of at least one span in all respects as specified in the column of "Stage of payment" in this sub clause.
<b>(3) Approaches:</b> On completion of approaches including retaining wall, stone pitching, protection work complete in all respects & fit for use.	0%	<b>Approaches:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of approaches in all respects as specified in the column of "Stage of payment" in this sub clause.
<b>(4) Guide Bunds and River Training works:</b> On completion Guide Bunds and River Training works complete in all respects	0%	<b>Guide Bunds and River Training works:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of Guide Bunds and River Training works complete in all respects as specification.
<b>B.1 Widening and repairs of underpasses/overpasses</b>	0%	Cost of each underpasses/overpasses shall be determined on pro rata basis with respect to the total linear length of the underpasses/overpasses. Payment shall be made on completion of widening & repair works of a underpasses/overpass.
<b>B.2-New underpasses/overpasses:</b>  <b>(i) Foundation +Sub-Structure:</b> On completion of the foundation work including foundations for wing and return walls, abutments, piers upto the abutment/pier cap.	0%	<b>Foundation:</b> Cost of each underpass/overpass shall be determined on pro rata basis with respect to the total linear length (m) of the underpass/overpass. Payment against foundation + Sub structure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of foundation of each underpass/overpass subject to completion of at least two foundations along with sub-structure up to abutment/pier cap level each

		underpass/overpass. In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.
(ii) <b>Super-structure:</b> On completion of the superstructure in all respects including wearing coat, bearings, expansion joints, hand rails, crash barriers, road signs & markings, tests on completion etc. complete in all respect. Wearing Coat (a) in case of Overpass- wearing coat including expansion joints complete in all respects as specified and (b) in case of underpass- rigid pavement including drainage facility complete in all respects as specified as specified.	0%	<b>Super-structure:</b>  Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure of at least one span in all respects as specified in the column of "Stage of payment" in this sub clause.
(iii) <b>Approaches:</b> On completion of approaches including Retaining walls/ Reinforced Earth walls, stone pitching, protection works complete in all Respect and fit for use.	0%	<b>Approaches:</b> Payment shall be made on pro-rata basis on completion of a stage i.e. completion of approaches in all respect as specified.

(iii) Major Bridge works ROB/RUB and Structures.

Procedure for estimating the value of major Bridge works, ROB/RUB and Structures shall be as stated in table 1.3.3:

Table 1.3.3

Stage of Payment	Weightage	Payment Procedure
<b>A.1- Widening and repairs of Major bridges</b>  <b>(i) Foundation:</b>	0%	<b>Foundation:</b>  Cost of each Major Bridge shall be determined on pro rata basis with respect to the total linear length (m) of the Major Bridges. payment against foundation shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of foundation of the major Bridge subject to completion of at least Two foundations of the major Bridge. In case where load testing is required for foundation, the trigger of first payment shall



		include load testing also where specified.
<b>(2)Substructure:</b>	0%	<b>Substructure:</b> Payment against Substructure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of substructure of the major bridge subject to completion of atleast two sub-structures of abutments /piers upto abutment/pier cap level of the major bridge.
<b>(3) Super-structure:</b> including bearing	0%	<b>Super-structure:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearing of at least one span in all respects as specified.
<b>(4) Wearing Coat including expansion Joints</b>	0%	<b>Wearing Coat:-</b> Payment shall be made on completion of wearing coat including expansion joint complete in all respects as specified.
<b>(5) Miscellaneous Items like</b> Hand Rails, Crash Barriers, Road Markings etc.	0%	<b>Miscellaneous:</b> Payment shall be made on Completion of all Misc Works like Hand Rails, Crash Barriers, Road Markings etc. complete in all respects as specified.
<b>(6) Wing Walls/Return Walls</b>	0%	<b>Wing Walls/Return Walls :</b> Payment shall be made on Completion of all wing walls/Return walls complete in all respects as specified.
<b>(7) Guide Bunds and River Training works, etc.</b>	0%	<b>Guide Bunds and River Training works:</b> Payment shall be made on completion of all Guide Bunds/River Training works etc. complete in all respects as specified.

<b>(8) Approaches:</b> (including retaining walls, stone pitching, protection works)	0%	<b>Approaches:</b> Payment shall be made on pro rata basis on completion of 10% of the scope of each stage.
<b>A.2- New Major bridges</b>  <b>(i)Foundation:</b>	0%	<b>Foundation:</b>  Cost of each Major Bridge shall be determined on pro rata basis with respect to the total linear length (m) of the Major Bridges. payment against foundation shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of foundation of the major Bridge subject to completion of at least Two foundations of the major Bridge. In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.
<b>(2)Substructure:</b>	0%	<b>Substructure:</b>  payment against substructure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of substructure of major bridge subject to completion of atleast two sub-structures of abutments/piers upto abutment/pier cap level of the major bridge.
<b>(3) Super-structure:</b> including bearings.	0%	<b>Super-structure:</b>  Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearing of at least one span in all respects as specified.
<b>(4) Wearing Coat including expansion joints</b>	0%	<b>Wearing Coat:-</b>  Payment shall be made on completion of wearing coat including expansion joint complete in all respects as specified.
<b>(5) Miscellaneous Items like</b> Hand Rails, Crash Barriers, Road Markings etc.	0%	<b>Miscellaneous:</b> Payment shall be made on Completion of all Misc Works like Hand Rails, Crash Barriers, Road Markings etc. complete in all respects as specified.

<b>(6) Wing Walls/Return Walls</b>	0%	<b>Wing Walls/Return Walls :</b> Payment shall be made on Completion of all wing walls/Return walls complete in all respects as specified.
<b>(7) Guide Bunds and River Training works, etc.</b>	0%	<b>Guide Bunds and River Training works:</b> Payment shall be made on completion of all Guide Bunds/River Training works etc. complete in all respects as specified.
<b>(8) Approaches:</b> (including retaining walls, stone pitching, protection works)	0%	<b>Approaches:</b> Payment shall be made on pro rata basis on completion of 10% of the scope of each stage.
<b>B.1- Widening and repairs of</b> <b>(a) ROB</b> <b>(b) RUB</b> (1)Foundation	0%	(i) Foundation: Cost of each ROB/RUB shall be determined on pro rata basis with respect to the total linear length (m) of the ROB/RUBs. Payment against foundation shall be made on prorata basis on completion of a stage i.e. not less than 25% of the scope of foundation of the ROB/RUB subject to completion of at least two foundations of the ROB/RUB.  In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.
(2) Sub-structure:	0%	(ii) Sub-Structure:. Payment against Substructure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of substructure of the ROB/RUB subject to completion of at least two sub-structures of abutments /piers upto abutment/pier cap level of the ROB/RUB.
(3) Super-structure (including bearings)	0%	<b>(iii) Super-structure:</b>  Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearings of atleast one span in all respects as specified.

(4) Wearing coat including expansion joints in case of ROB. In case of RUB, rigid pavement under RUB including drainage facility as Specified.	0%	<b>(iv) Wearing coat:</b> Payment shall be made on completion of (a) in case of ROB- wearing coat including expansion joints complete in all respects as specified and (b) in case of RUB- rigid pavement under RUB including drainage facility complete in all respects as specified.
(5) Miscellaneous Items like hand rail, crash barriers, road markings etc.	0%	<b>(v) Miscellaneous:</b> Payment shall be made on completion of miscellaneous work like hand rail, crash barriers, road markings etc. complete in all respects as specified.
(6) Wing walls/return walls	0%	<b>(vi) Wing walls/return walls:</b> Payment shall be made on completion of all wing walls/return walls complete in all respects as specified.
<b>(7) Approaches:</b> (including Retaining walls, stone pitching and protection works)	0%	<b>Approaches:</b> Payment shall be made on pro rata basis on completion of a stage in all respect as specified.
<b>B.2- New ROB/RUB</b> (1) Foundation	0%	(i) Foundation: Cost of each ROB/RUB shall be determined on pro rata basis with respect to the total linear length (m) of the ROB/RUBs. Payment against foundation shall be made on prorata basis on completion of a stage i.e. not less than 25% of the scope of foundation of the ROB/RUB subject to completion of at least two foundations of the ROB/RUB.  In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.
(2) Sub-structure:	0%	(ii) Sub-Structure:. Payment against Substructure shall be made on pro-rata basis on completion of a stage i.e. not less than 25% of the scope of substructure of the ROB/RUB subject to completion of at least two sub-structures of abutments /piers upto abutment/pier cap level of the ROB/RUB.

(3) Super-structure (including bearings)	0%	<b>(iii) Super-structure:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearings of atleast one span in all respects as specified.
(4) Wearing coat including expansion joints in case of ROB. In case of RUB, rigid pavement under RUB including drainage facility as Specified.	0%	<b>(iv) Wearing coat:</b> Payment shall be made on completion of (a) in case of ROB- wearing coat including expansion joints complete in all respects as specified and (b) in case of RUB- rigid pavement under RUB including drainage facility complete in all respects as specified.
(5) Miscellaneous Items like hand rail, crash barriers, road markings etc.	0%	<b>(v) Miscellaneous:</b> Payment shall be made on completion of miscellaneous work like hand rail, crash barriers, road markings etc. complete in all respects as specified.
(6) Wing walls/return walls	0%	<b>(vi) Wing walls/return walls:</b> Payment shall be made on completion of all wing walls/return walls complete in all respects as specified.
<b>(7) Approaches:</b> (including Retaining walls, stone pitching and protection works)	0%	<b>Approaches:</b> Payment shall be made on pro rata basis on completion of a stage in all respect as specified.
<b>C.1- Widening &amp; Repairs of Elevated Section/Flyovers/Grade Seperators.</b> (1)Foundation	0%	(i) Foundation: Cost of each structure shall be determined on pro rata basis with respect to the total linear length (m) of the structures. Payment against foundation shall be made on prorated basis on completion of a stage i.e. not less than 25% of the scope of foundation of the structure subject to completion of atleast two foundations of the structure .  In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.

(2) Sub-structure:	0%	<b>(ii) Sub-structure:</b> Payment against Sub- structure shall be made on pro rata basis on completion of a stage i.e. not less than 25% of the scope of sub-structure of the Structure subject to completion of atleast two sub-structures of abutments/piers upto abutment/pier cap level of the structure..
(3) Super-structure : including Bearings.	0%	<b>(iii) Super-structure:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearings of atleast one span in all respects as specified.
(4) Wearing coat including expansion joints.	0%	<b>(iv) Wearing coat:</b> Payment shall be made on completion of wearing coat including expansion Joints Complete in all respect as specified.
(5) Miscellaneous Items like hand rail, crash barriers, road markings etc.	0%	<b>(v) Miscellaneous:</b> Payment shall be made on completion of miscellaneous work like hand rail, crash barriers, road markings etc. complete in all respects as specified.
(6) Wing walls/return walls	0%	<b>(vi) Wing walls/return walls:</b> Payment shall be made on completion of all wing walls/return walls complete in all respects as specified.
<b>(7) Approaches:</b> (including Retaining walls/Reinforced Earth wall, stone pitching and protection works)	0%	Payment shall be made on pro rata basis on completion of a stage in all respect as specified.
<b>C.2- New Elevated Section/Flyovers/Grade Seperators.</b> (1)Foundation	0%	(i) Foundation: Cost of each structure shall be determined on pro rata basis with respect to the total linear length (m) of the structures. Payment against foundation shall be made on prorata basis on completion of a stage i.e. not less than 25% of the scope of foundation of the structure subject to completion of atleast two foundations of the structure .  In case where load testing is required for foundation, the trigger of first payment shall include load testing also where specified.

(2) Sub-structure:	0%	<b>(ii) Sub-structure:</b> Payment against Sub- structure shall be made on pro rata basis on completion of a stage i.e. not less than 25% of the scope of sub-structure of the Structure subject to completion of atleast two sub-structures of abutments/piers upto abutment/pier cap level of the structure..
(3) Super-structure : including Bearings.	0%	<b>(iii) Super-structure:</b> Payment shall be made on pro rata basis on completion of a stage i.e. completion of super-structure including bearings of atleast one span in all respects as specified.
(4) Wearing coat including expansion joints.	0%	<b>(iv) Wearing coat:</b> Payment shall be made on completion of wearing coat including expansion Joints Complete in all respect as specified.
(5) Miscellaneous Items like hand rail, crash barriers, road markings etc.	0%	<b>(v) Miscellaneous:</b> Payment shall be made on completion of miscellaneous work like hand rail, crash barriers, road markings etc. complete in all respects as specified.
(6) Wing walls/return walls	0%	<b>(vi) Wing walls/return walls:</b> Payment shall be made on completion of all wing walls/return walls complete in all respects as specified.
<b>(7) Approaches:</b> (including Retaining walls/Reinforced Earth wall, stone pitching and protection works)	0%	Payment shall be made on pro rata basis on completion of a stage in all respect as specified.

Note: (1) In case of innovate Major Bridge projects like cable suspension/cable stayed/ Extra Dozed and exceptionally long span bridges, the schedule may be modified as per site requirements before bidding with due approval of DG(RD)&SS, MoRT&H.

(2) The Schedule for exclusive tunnel projects may be prepared as per site requirements before bidding with due approval of DG(RD)&SS, MoRT&H.

(iv) Other works.

Procedure for estimating the value of other works done shall be as stated in table 1.3.4.

**Table 1.3.4**

Stage of Payment	Weightage	Payment Procedure
(i) Toll plaza	0%	Unit of measurement is each completed toll plaza. Payment of each toll plaza shall be made on pro rata basis with respect to the total of all toll plazas.
(ii) Road side drains	11.19%	Unit of measurement is linear length in km. Payment shall be made on pro rata basis on completion of a stage in a length of not less than 10 % (ten per cent) of the total length.
(iii) Road signs, markings, km stones, safety devices,...	5.78%	
(iv) Project Facilities		Payment shall be made on pro rata basis for completed facilities.
a) Bus bays	1.54%	
b) Truck lay-byes	0%	
c) Rest areas	0%	
d) others	0%	
(v) Road side plantation	0%	
(vi) Repair of protection works other than approaches to the bridges, elevated sections/ flyovers/grade separators and ROB/RUBs.	0%	
(vii) Safety and traffic management during construction	0.01%	Payment shall be made on pro rata basis every six months.
(viii) Site Clearance	0.30%	
(ix) Retaining Wall	81.19%	

## **2. Procedure for payment for Maintenance**

a) The cost for maintenance shall be as stated in Clause 14.1.1.

b) Payment for Maintenance shall be made in quarterly instalments in accordance with the provisions of Clause 19.7.



## Schedule - I

(See Clause 10.2 (iv))

### Drawings

1. Drawings

In compliance of the obligations set forth in Clause 10.2 of this Agreement, the Contractor shall furnish to the Authority's Engineer, free of cost, all Drawings listed in Annex-I of this Schedule-I.

2. Additional Drawings

If the Authority's Engineer determines that for discharging its duties and functions under this Agreement, it requires any drawings other than those listed in Annex-I, it may by notice require the Contractor to prepare and furnish such drawings forthwith. Upon receiving a requisition to this effect, the Contractor shall promptly prepare and furnish such drawings to the Authority's Engineer, as if such drawings formed part of Annex-I of this Schedule-I.

## Annex – I

(Schedule - I)

### List of Drawings

1. A minimum list of the drawings of the various components/elements of the project highway and project facility required to be submitted by the Contractor is given below:
  - (a) Drawing of horizontal alignment, vertical profile and detailed cross sections
  - (b) Drawings of cross drainage works i.e. Bridges/Culverts/Flyovers and Other Structures.
  - (c) Drawings for River Training works
  - (d) Drawings of interchanges, major intersections and underpasses
  - (e) Drawing of control centre
  - (f) Drawings of road furniture items including traffic signage, marking, safety barriers, etc.
  - (g) Drawings of traffic diversions plans and traffic control measures
  - (h) Drawings of road drainage measures
  - (i) Drawings of typical details slope protection measures
  - (j) Drawings of landscaping and horticulture
  - (k) Drawings of pedestrian crossing
  - (k) Drawings of street lighting
  - (l) Any other drawings as per instruction of Authority Engineer
  - (m) General Arrangement showing Base Camp and Administrative Block

## Schedule - J

(See Clause 10.3 (ii))

### Project Completion Schedule

#### 1. Project Completion Schedule

During Construction period, the Contractor shall comply with the requirements set forth in this Schedule-J for each of the Project Milestones and the Scheduled Completion Date. Within 15 (fifteen) days of the date of each Project Milestone, the Contractor shall notify the Authority of such compliance along with necessary particulars thereof.

#### 2. Project Milestone-I

- (i) Project Milestone-I shall occur on the date falling on the 55<sup>th</sup> day from the Appointed Date (the "Project Milestone- I").
- (ii) Prior to the occurrence of Project Milestone-I, the Contractor shall have commenced construction of the Project Highway and submitted to the Authority duly and validly prepared Stage Payment Statements for an amount not less than 10% (ten per cent) of the Contract Price.

#### 3. Project Milestone-II

- (i) Project Milestone-II shall occur on the date falling on the 192<sup>nd</sup> day from the Appointed Date (the "Project Milestone- II").
- (ii) Prior to the occurrence of Project Milestone-II, the Contractor shall have continued with construction of the Project Highway and submitted to the Authority duly and validly prepared Stage Payment Statements for an amount not less than 35% (thirty five per cent) of the Contract Price and should have started construction of all bridges.

#### 4. Project Milestone-III

- (i) Project Milestone-III shall occur on the date falling on the 384<sup>th</sup> day from the Appointed Date (the "Project Milestone- III").
- (ii) Prior to the occurrence of Project Milestone-III, the Contractor shall have continued with construction of the Project Highway and submitted to the Authority duly and validly prepared Stage Payment Statements for an amount not less than 70% (seventy per cent) of the Contract Price and should have started construction of all project facilities.

#### 5. Scheduled Completion Date

- (i) The Scheduled Completion Date shall occur on the 548<sup>th</sup> day from the Appointed Date.
- (ii) On or before the Scheduled Completion Date, the Contractor shall have completed construction in accordance with this Agreement.

6. Extension of time

Upon extension of any or all of the aforesaid Project Milestones or the Scheduled Completion Date, as the case may be, under and in accordance with the provisions of this Agreement, the Project Completion Schedule shall be deemed to have been amended accordingly.

## Schedule - K

(See Clause 12.1 (ii))

### Tests on Completion

#### 1. Schedule for Tests

- (i) The Contractor shall, no later than 30 (thirty) days prior to the likely completion of construction, notify the Authority's Engineer and the Authority of its intent to subject the Project Highway to Tests, and no later than 10 (ten) days prior to the actual date of Tests, furnish to the Authority's Engineer and the Authority detailed inventory and particulars of all works and equipment forming part of Works.
- (ii) The Contractor shall notify the Authority's Engineer of its readiness to subject the Project Highway to Tests at any time after 10 (ten) days from the date of such notice, and upon receipt of such notice, the Authority's Engineer shall, in consultation with the Contractor, determine the date and time for each Test and notify the same to the Authority who may designate its representative to witness the Tests. The Authority's Engineer shall thereupon conduct the Tests itself or cause any of the Tests to be conducted in accordance with Article 12 and this Schedule-K.

#### 2. Tests

- (i) Visual and physical test: The Authority's Engineer shall conduct a visual and physical check of construction to determine that all works and equipment forming part thereof conform to the provisions of this Agreement. The physical tests shall include (to be decided in consultation with Authority's Engineer as per relevant IRC codes/manual).
- (ii) Riding quality test: Riding quality of each lane of the carriageway shall be checked with the help of a Network Survey Vehicle (NSV) fitted with latest equipments and the maximum permissible roughness for purposes of this Test shall be 2,000 (two thousand) mm for each kilometre.
- (iii) Tests for bridges: All major and minor bridges shall be subjected to the rebound hammer and ultrasonic pulse velocity tests, to be conducted in accordance with the procedure described in Special Report No. 17: 1996 of the IRC Highway Research Board on Non-destructive Testing Techniques, at two spots in every span, to be chosen at random by the Authority's Engineer. Bridges with a span of 15 (fifteen) metres or more shall also be subjected to load testing.
- (iv) Other tests: The Authority's Engineer may require the Contractor to carry out or cause to be carried additional tests, in accordance with Good Industry Practice, for determining the compliance of the Project Highway with Specifications and Standards, except tests as specified in clause 5, but shall include measuring the reflectivity of road markings and road signs; and measuring the illumination level (lux) of lighting using requisite testing equipment.

- (v) Environmental audit: The Authority's Engineer shall carry out a check to determine conformity of the Project Highway with the environmental requirements set forth in Applicable Laws and Applicable Permits.
- (vi) Safety Audit: The Authority's Engineer shall carry out, or cause to be carried out, a safety audit to determine conformity of the Project Highway with the safety requirements and Good Industry Practice.

3. Agency for conducting Tests

All Tests set forth in this Schedule-K shall be conducted by the Authority's Engineer or such other agency or person as it may specify in consultation with the Authority.

4. Completion Certificate

Upon successful completion of Tests, the Authority's Engineer shall issue the Completion Certificate in accordance with the provisions of Article 12.

- 5. The Authority Engineer will carry out tests with following equipment at his own cost in the presence of contractor's representative.

Sr. No.	Key metrics of Asset	Equipment to be used	Frequency of condition survey
1	Surface defects of pavement	Network Survey Vehicle (NSV)	At least twice a year (As per survey months defined for the state basis rainy season)
2	Roughness of pavement	Network Survey Vehicle (NSV)	At least twice a year (As per survey months defined for the state basis rainy season)
3	Strength of pavement	Falling Weight Deflectometer (FWD)	At least once a year
4	Bridges	Mobile Bridge Inspection Unit (MBU)	At least twice a year (As per survey months defined for the state basis rainy season)
5	Road signs	Retro-reflectometer	At least twice a year (As per survey months defined for the state basis rainy season)

The first testing with the help of NSV shall be conducted at the time of issue of Completion Certificate.

Schedule - L (See Clause 12.2)

Completion Certificate

- 1 I, ..... (Name of the Authority's Engineer), acting as the Authority's Engineer, under and in accordance with the Agreement dated ..... (the "Agreement"), for **"Rehabilitation and up-gradation of road from km 46.597 to km 66.845 (Total length: 20.248 km) of Kanchanpur- Vagmun section on NH-44A to two lane with paved shoulder in the state of Tripura on EPC basis- (package-III)"** (the "Project Highway") on Engineering, Procurement and Construction (EPC) basis through ..... (Name of Contractor), hereby certify that the Tests in accordance with Article 12 of the Agreement have been successfully undertaken to determine compliance of the Project Highway with the provisions of the Agreement, and I am satisfied that the Project Highway can be safely and reliably placed in service of the Users thereof.
- 2 It is certified that, in terms of the aforesaid Agreement, all works forming part of Project Highway have been completed, and the Project Highway is hereby declared fit for entry into operation on this the ..... day of ..... 20..... , Scheduled Completed Date for which was the ..... day of .....20.....

SIGNED, SEALED AND DELIVERED For

and on behalf of the Authority's Engineer by:

(Signature)

(Name)

(Designation) (Address)

## Schedule - M

(See Clauses 14.6, 15.2 and 19.7)

### Payment Reduction for Non-Compliance

1. Payment reduction for non-compliance with the Maintenance Requirements
  - (i) Monthly lump sum payments for maintenance shall be reduced in the case of non-compliance with the Maintenance Requirements set forth in Schedule-E.
  - (ii) Any deduction made on account of non-compliance with the Maintenance Requirements shall not be paid even after compliance subsequently. The deductions shall continue to be made every month until compliance is done.
  - (iii) The Authority's Engineer shall calculate the amount of payment reduction on the basis of weightage in percentage assigned to non-conforming items as given in Paragraph 2.
2. Percentage reductions in lump sum payments on monthly basis
  - (i) The following percentages shall govern the payment reduction:

S. No.	Item/Defect/Deficiency	Percentage
(a)	Carriageway/Pavement	
(i)	Potholes, cracks, other surface defects	15%
(ii)	Repairs of Edges, Rutting	5%
(b)	Road, Embankment, Cuttings, Shoulders	
(i)	Edge drop, inadequate cross fall, undulations, settlement, potholes, ponding, obstructions	10%
(ii)	Deficient slopes, raincuts, disturbed pitching, vegetation growth, pruning of trees	5%
(c)	Bridges and Culverts	
(i)	Desilting, cleaning, vegetation growth, damaged pitching, flooring, parapets, wearing course, footpaths, any damage to foundations	20%
(ii)	Any Defects in superstructures, bearings and sub-structures	10%



S. No.	Item/Defect/Deficiency	Percentage
(iii)	Painting, repairs/replacement kerbs, railings, parapets, guideposts/crash barriers	5%
(d)	Roadside Drains	
(i)	Cleaning and repair of drains	5%
(e)	Road Furniture	
(i)	Cleaning, painting, replacement of road signs, delineators, road markings, 200 m/km/5 <sup>th</sup> km stones	5%
(f)	Miscellaneous Items	
(i)	Removal of dead animals, broken down/accident vehicles, fallen trees, road blockades or malfunctioning of mobile crane	10%
(ii)	Any other Defects in accordance with paragraph 1.	5%
(g)	Defects in Other Project Facilities	5%

- (ii) The amount to be deducted from monthly lump-sum payment for non-compliance of particular item shall be calculated as under:

$$R = P/100 \times (M_1 \text{ or } M_2) \times L_1/L$$

Where,

P= Percentage of particular item/Defect/deficiency for deduction

M1= Monthly lump-sum payment in accordance para 1.2 above of this Schedule M2=

Monthly lump-sum payment in accordance para 1.2 above of this Schedule L1= Non-

complying length L = Total length of the road,

R= Reduction (the amount to be deducted for non-compliance for a particular item/Defect/deficiency

The total amount of reduction shall be arrived at by summation of reductions for such items/Defects/deficiency or non-compliance.

For any Defect in a part of one kilometer, the non-conforming length shall be taken as one kilometer.

## Schedule - N

(See Clause 18.1 (i))

### Selection of Authority's Engineer

#### 1. Selection of Authority's Engineer

- (i) The provisions of the Model Request for Proposal for Selection of Technical Consultants, issued by the Ministry of Finance in May 2009, or any substitute thereof shall apply for selection of an experienced firm to discharge the functions and duties of an Authority's Engineer.
- (ii) In the event of termination of the Technical Consultants appointed in accordance with the provisions of Paragraph 1.1, the Authority shall appoint another firm of Technical Consultants forthwith and may engage a government-owned entity in accordance with the provisions of Paragraph 3 of this Schedule-N.

#### 2. Terms of Reference

The Terms of Reference for the Authority's Engineer (the "TOR") shall substantially conform with Annex 1 to this Schedule N.

#### 3. Appointment of Government entity as Authority's Engineer

Notwithstanding anything to the contrary contained in this Schedule, the Authority may in its discretion appoint a government-owned entity as the Authority's Engineer; provided that such entity shall be a body corporate having as one of its primary functions the provision of consulting, advisory and supervisory services for engineering projects; provided further that a government-owned entity which is owned or controlled by the Authority shall not be eligible for appointment as Authority's Engineer.

## Annex – I

### (Schedule - N)

#### Terms of Reference for Authority's Engineer

##### 1. Scope

- (i) These Terms of Reference (the "TOR") for the Authority's Engineer are being specified pursuant to the EPC Agreement dated ..... (the "Agreement"), which has been entered into between the National Highways and Infrastructure Development Corporation Ltd, 3rd Floor, PTI Building, 4, Parliament Street, New Delhi – 110001 (the "Authority") and ..... (the "Contractor")<sup>#</sup> for "Rehabilitation and up-gradation of road from km 46.597 to km 66.845 (Total length: 20.248 km) of Kanchanpur- Vagmun section on NH-44A to two lane with paved shoulder in the state of Tripura on EPC basis- (package-III)66.845, and a copy of which is annexed hereto and marked as Annex-A to form part of this TOR.
- (ii) The TOR shall apply to construction and maintenance of the Project Highway.

##### 2. Definitions and interpretation

- (i) The words and expressions beginning with or in capital letters and not defined herein but defined in the Agreement shall have, unless repugnant to the context, the meaning respectively assigned to them in the Agreement.
- (ii) References to Articles, Clauses and Schedules in this TOR shall, except where the context otherwise requires, be deemed to be references to the Articles, Clauses and Schedules of the Agreement, and references to Paragraphs shall be deemed to be references to Paragraphs of this TOR.
- (iii) The rules of interpretation stated in Article 1 of the Agreement shall apply, mutatis mutandis, to this TOR.

##### 3. General

- (i) The Authority's Engineer shall discharge its duties in a fair, impartial and efficient manner, consistent with the highest standards of professional integrity and Good Industry Practice.
- (ii) The Authority's Engineer shall perform the duties and exercise the authority in accordance with the provisions of this Agreement, but subject to obtaining prior written approval of the Authority before determining:
  - (a) any Time Extension;
  - (b) any additional cost to be paid by the Authority to the Contractor;
  - (c) the Termination Payment; or
  - (d) issuance of Completion Certificate or

- (e) any other matter which is not specified in (a), (b), (c) or (d) above and which creates a financial liability on either Party.
- (iii) The Authority's Engineer shall submit regular periodic reports, at least once every month, to the Authority in respect of its duties and functions under this Agreement. Such reports shall be submitted by the Authority's Engineer within 10 (ten) days of the beginning of every month.
- (iv) The Authority's Engineer shall inform the Contractor of any delegation of its duties and responsibilities to its suitably qualified and experienced personnel; provided, however, that it shall not delegate the authority to refer any matter for the Authority's prior approval in accordance with the provisions of Clause 18.2.
- (v) The Authority's Engineer shall aid and advise the Authority on any proposal for Change of Scope under Article 13.
- (vi) In the event of any disagreement between the Parties regarding the meaning, scope and nature of Good Industry Practice, as set forth in any provision of the Agreement, the Authority's Engineer shall specify such meaning, scope and nature by issuing a reasoned written statement relying on good industry practice and authentic literature.

#### 4. Construction Period

- (i) During the Construction Period, the Authority's Engineer shall review and approve the Drawings furnished by the Contractor along with supporting data, including the geo-technical and hydrological investigations, characteristics of materials from borrow areas and quarry sites, topographical surveys, and the recommendations of the Safety Consultant in accordance with the provisions of Clause 10.1 (vi). The Authority's Engineer shall complete such review and approval and send its observations to the Authority and the Contractor within 15 (fifteen) days of receipt of such Drawings; provided, however that in case of a Major Bridge or Structure, the aforesaid period of 15 (fifteen) days may be extended upto 30 (thirty) days. In particular, such comments shall specify the conformity or otherwise of such Drawings with the Scope of the Project and Specifications and Standards.
- (ii) The Authority's Engineer shall review and approve any revised Drawings sent to it by the Contractor and furnish its comments within 10 (ten) days of receiving such Drawings.
- (iii) The Authority's Engineer shall review and approve the Quality Assurance Plan submitted by the Contractor and shall convey its comments to the Contractor within a period of 21 (twenty one) days stating the modifications, if any, required thereto.
- (iv) The Authority's Engineer shall complete the review and approve of the methodology proposed to be adopted by the Contractor for executing the Works, and convey its comments to the Contractor within a period of 10 (ten) days from the date of receipt of the proposed methodology from the Contractor.
- (v) The Authority's Engineer shall grant written approval to the Contractor, where necessary, for interruption and diversion of the flow of traffic in the existing lane(s) of the Project Highway for purposes of maintenance during the Construction Period in accordance

with the provisions of Clause 10.4.

- (vi) The Authority's Engineer shall review the monthly progress report furnished by the Contractor and send its comments thereon to the Authority and the Contractor within 7 (seven) days of receipt of such report.
- (vii) The Authority's Engineer shall inspect the Construction Works and the Project Highway and shall submit a monthly Inspection Report bringing out the results of inspections and the remedial action taken by the Contractor in respect of Defects or deficiencies. In particular, the Authority's Engineer shall include in its Inspection Report, the compliance of the recommendations made by the Safety Consultant.
- (viii) The Authority's Engineer shall conduct the pre-construction review of manufacturer's test reports and standard samples of manufactured Materials, and such other Materials as the Authority's Engineer may require.
- (ix) For determining that the Works conform to Specifications and Standards, the Authority's Engineer shall require the Contractor to carry out, or cause to be carried out, tests at such time and frequency and in such manner as specified in the Agreement and in accordance with Good Industry Practice for quality assurance. For purposes of this Paragraph 4 (ix), the tests specified in the IRC Special Publication-11 (Handbook of Quality Control for Construction of Roads and Runways) and the Specifications for Road and Bridge Works issued by MORTH (the "Quality Control Manuals") or any modification/substitution thereof shall be deemed to be tests conforming to Good Industry Practice for quality assurance.
- (x) The Authority's Engineer shall test check at least 50 (fifty) percent of the quantity or number of tests prescribed for each category or type of test for quality control by the Contractor.
- (xi) The timing of tests referred to in Paragraph 4 (ix), and the criteria for acceptance/rejection of their results shall be determined by the Authority's Engineer in accordance with the Quality Control Manuals. The tests shall be undertaken on a random sample basis and shall be in addition to, and independent of, the tests that may be carried out by the Contractor for its own quality assurance in accordance with Good Industry Practice.
- (xii) In the event that results of any tests conducted under Clause 11.10 establish any Defects or deficiencies in the Works, the Authority's Engineer shall require the Contractor to carry out remedial measures.

- (xiii) The Authority's Engineer may instruct the Contractor to execute any work which is urgently required for the safety of the Project Highway, whether because of an accident, unforeseeable event or otherwise; provided that in case of any work required on account of a Force Majeure Event, the provisions of Clause 21.6 shall apply.
- (xiv) In the event that the Contractor fails to achieve any of the Project Milestones, the Authority's Engineer shall undertake a review of the progress of construction and identify potential delays, if any. If the Authority's Engineer shall determine that completion of the Project Highway is not feasible within the time specified in the Agreement, it shall require the Contractor to indicate within 15 (fifteen) days the steps proposed to be taken to expedite progress, and the period within which the Project Completion Date shall be achieved. Upon receipt of a report from the Contractor, the Authority's Engineer shall review the same and send its comments to the Authority and the Contractor forthwith.
- (xv) The Authority's Engineer shall obtain from the Contractor a copy of all the Contractor's quality control records and documents before the Completion Certificate is issued pursuant to Clause 12.2.
- (xvi) Authority's Engineer may recommend to the Authority suspension of the whole or part of the Works if the work threatens the safety of the Users and pedestrians. After the Contractor has carried out remedial measure, the Authority's Engineer shall inspect such remedial measures forthwith and make a report to the Authority recommending whether or not the suspension hereunder may be revoked.
- (xvii) In the event that the Contractor carries out any remedial measures to secure the safety of suspended works and Users, and requires the Authority's Engineer to inspect such works, the Authority's Engineer shall inspect the suspended works within 3 (three) days of receiving such notice, and make a report to the Authority forthwith, recommending whether or not such suspension may be revoked by the Authority.
- (xviii) The Authority's Engineer shall carry out, or cause to be carried out, all the Tests specified in Schedule-K and issue a Completion Certificate, as the case may be. For carrying out its functions under this Paragraph 4 (xviii) and all matters incidental thereto, the Authority's Engineer shall act under and in accordance with the provisions of Article 12 and Schedule-K.

## 5. Maintenance Period

- (i) The Authority's Engineer shall aid and advise the Contractor in the preparation of its monthly Maintenance Programme and for this purpose carry out a joint monthly inspection with the Contractor.
- (ii) The Authority's Engineer shall undertake regular inspections, at least once every month, to evaluate compliance with the Maintenance Requirements and submit a Maintenance Inspection Report to the Authority and the Contractor.

- (iii) The Authority's Engineer shall specify the tests, if any, that the Contractor shall carry out, or cause to be carried out, for the purpose of determining that the Project Highway is in conformity with the Maintenance Requirements. It shall monitor and review the results of such tests and the remedial measures, if any, taken by the Contractor in this behalf.
- (iv) In respect of any defect or deficiency referred to in Paragraph 3 of Schedule- E, the Authority's Engineer shall, in conformity with Good Industry Practice, specify the permissible limit of deviation or deterioration with reference to the Specifications and Standards and shall also specify the time limit for repair or rectification of any deviation or deterioration beyond the permissible limit.
- (v) The Authority's Engineer shall examine the request of the Contractor for closure of any lane(s) of the Project Highway for undertaking maintenance/repair thereof, and shall grant permission with such modifications, as it may deem necessary, within 5 (five) days of receiving a request from the Contractor. Upon expiry of the permitted period of closure, the Authority's Engineer shall monitor the reopening of such lane(s), and in case of delay, determine the Damages payable by the Contractor to the Authority under Clause 14.5.

6. Determination of costs and time

- (i) The Authority's Engineer shall determine the costs, and/or their reasonableness, that are required to be determined by it under the Agreement.
- (ii) The Authority's Engineer shall determine the period of Time Extension that is required to be determined by it under the Agreement.
- (iii) The Authority's Engineer shall consult each Party in every case of determination in accordance with the provisions of Clause 18.5.

7. Payments

- (i) The Authority's Engineer shall withhold payments for the affected works for which the Contractor fails to revise and resubmit the Drawings to the Authority's Engineer in accordance with the provisions of Clause 10.2 (iv) (d).
- (ii) Authority's Engineer shall -
  - (a) within 10 (ten) days of receipt of the Stage Payment Statement from the Contractor pursuant to Clause 19.4, determine the amount due to the Contractor and recommend the release of 90 (ninety) percent of the amount so determined as part payment, pending issue of the Interim Payment Certificate; and
  - (b) within 15 (fifteen) days of the receipt of the Stage Payment Statement referred to in Clause 19.4, deliver to the Authority and the Contractor an Interim Payment Certificate certifying the amount due and payable to the Contractor, after adjustments in accordance with the provisions of Clause 19.10.
- (iii) The Authority's Engineer shall, within 15 (fifteen) days of receipt of the Monthly

Maintenance Statement from the Contractor pursuant to Clause 19.6, verify the Contractor's monthly statement and certify the amount to be paid to the Contractor in accordance with the provisions of the Agreement.

- (iv) The Authority's Engineer shall certify final payment within 30 (thirty) days of the receipt of the final payment statement of Maintenance in accordance with the provisions of Clause 19.16.

8. Other duties and functions

The Authority's Engineer shall perform all other duties and functions as specified in the Agreement.

9. Miscellaneous

- (i) A copy of all communications, comments, instructions, Drawings or Documents sent by the Authority's Engineer to the Contractor pursuant to this TOR, and a copy of all the test results with comments of the Authority's Engineer thereon, shall be furnished by the Authority's Engineer to the Authority forthwith.
- (ii) The Authority's Engineer shall retain at least one copy each of all Drawings and Documents received by it, including 'as-built' Drawings, and keep them in its safe custody.
- (iii) Within 90 (ninety) days of the Project Completion Date, the Authority's Engineer shall obtain a complete set of as-built Drawings, in 2 (two) hard copies and in micro film form or in such other medium as may be acceptable to the Authority, reflecting the Project Highway as actually designed, engineered and constructed, including an as-built survey illustrating the layout of the Project Highway and setback lines, if any, of the buildings and structures forming part of Project Facilities; and shall hand them over to the Authority against receipt thereof.
- (iv) The Authority's Engineer, if called upon by the Authority or the Contractor or both, shall mediate and assist the Parties in arriving at an amicable settlement of any Dispute between the Parties.
- (v) The Authority's Engineer shall inform the Authority and the Contractor of any event of Contractor's Default within one week of its occurrence.



## Schedule - O

(See Clauses 19.4 (i), 19.6 (i), and 19.8 (i))

### Forms of Payment Statements

#### 1. Stage Payment Statement for Works

The Stage Payment Statement for Works shall state:

- (a) the estimated amount for the Works executed in accordance with Clause 19.3 (i) subsequent to the last claim;
- (b) amounts reflecting adjustments in price for the aforesaid claim;
- (c) the estimated amount of each Change of Scope Order executed subsequent to the last claim;
- (d) amounts reflecting adjustment in price, if any, for (c) above in accordance with the provisions of Clause 13.2 (iii) (a);
- (e) total of (a), (b), (c) and (d) above;
- (f) Deductions:
  - i. Any amount to be deducted in accordance with the provisions of the Agreement except taxes;
  - ii. Any amount towards deduction of taxes; and
  - iii. Total of (i) and (ii) above.
- (g) Net claim: (e) – (f) (iii);
- (h) The amounts received by the Contractor upto the last claim:
  - i. For the Works executed (excluding Change of Scope orders);
  - ii. For Change of Scope Orders, and
  - iii. Taxes deducted

#### 2. Monthly Maintenance Payment Statement

The monthly Statement for Maintenance Payment shall state:

- (a) the monthly payment admissible in accordance with the provisions of the Agreement;
- (b) the deductions for maintenance work not done;
- (c) net payment for maintenance due, (a) minus (b);
- (d) amounts reflecting adjustments in price under Clause 19.12; and
- (e) amount towards deduction of taxes

#### 3. Contractor's claim for Damages

Note: The Contractor shall submit its claims in a form acceptable to the Authority.

Schedule - P  
(See Clause 20.1)  
Insurance

1. Insurance during Construction Period

- (i) The Contractor shall effect and maintain at its own cost, from the Appointed Date till the date of issue of the Completion Certificate, the following insurances for any loss or damage occurring on account of Non Political Event of Force Majeure, malicious act, accidental damage, explosion, fire and terrorism:
  - (a) insurance of Works, Plant and Materials and an additional sum of [15 (fifteen)] per cent of such replacement cost to cover any additional costs of and incidental to the rectification of loss or damage including professional fees and the cost of demolishing and removing any part of the Works and of removing debris of whatsoever nature; and
  - (b) insurance for the Contractor's equipment and Documents brought onto the Site by the Contractor, for a sum sufficient to provide for their replacement at the Site.
- (ii) The insurance under sub para (a) and (b) of paragraph 1(i) above shall cover the Authority and the Contractor against all loss or damage from any cause arising under paragraph 1.1 other than risks which are not insurable at commercial terms.

2. Insurance for Contractor's Defects Liability

The Contractor shall effect and maintain insurance cover of not less than 15% of the Contract Price for the Works from the date of issue of the Completion Certificate until the end of the Defects Liability Period for any loss or damage for which the Contractor is liable and which arises from a cause occurring prior to the issue of the Completion Certificate. The Contractor shall also maintain other insurances for maximum sums as may be required under the Applicable Laws and in accordance with Good Industry Practice.

3. Insurance against injury to persons and damage to property

- (i) The Contractor shall insure against its liability for any loss, damage, death or bodily injury, or damage to any property (except things insured under Paragraphs 1 and 2 of this Schedule or to any person (except persons insured under Clause 20.9), which may arise out of the Contractor's performance of this Agreement. This insurance shall be for a limit per occurrence of not less than the amount stated below with no limit on the number of occurrences.

The insurance cover shall be not less than value of the contract price.

- (ii) The insurance shall be extended to cover liability for all loss and damage to the Authority's property arising out of the Contractor's performance of this Agreement excluding:
  - (a) the Authority's right to have the construction works executed on, over, under, in or

through any land, and to occupy this land for the Works; and

- (b) damage which is an unavoidable result of the Contractor's obligations to execute the Works.

4. Insurance to be in joint names

The insurance under paragraphs 1 to 3 above shall be in the joint names of the Contractor and the Authority.

## Schedule-Q

(See Clause 14.10)

### Tests on Completion of Maintenance Period

1. Riding Quality test:

Riding quality test: Riding quality of each lane of the carriageway shall be checked with the help of a calibrated bump integrator and the maximum permissible roughness for purposes of this Test shall be 2,200 (two thousand and two hundred only) mm for each kilometre.

2. Visual and physical test:

The Authority's Engineer shall conduct a visual and physical check of construction to determine that all works and equipment forming part thereof conform to the provisions of this Agreement. The physical tests shall include measurement of cracking, rutting, stripping and potholes and shall be as per the requirement of maintenance mentioned in Schedule-E.

## Schedule-R

(See Clause 14.10)

### Taking Over Certificate

I, ..... (Name and designation of the Authority's Representative) under and in accordance with the Agreement dated ..... (the "Agreement"), for "**Rehabilitation and up-gradation of road from km 46.597 to km 66.845 (Total length: 20.248 km) of Kanchanpur-Vaghmun section on NH-44A to two lane with paved shoulder in the state of Tripura on EPC basis- (package-III)**" through ..... (Name of Contractor), hereby certify that the Tests on completion of Maintenance Period in accordance with Article 14 of the Agreement have been successfully undertaken to determine compliance of the Project Highway with the provisions of the Agreement and I hereby certify that the Authority has taken over the Project highway from the Contractor on this day.....

SIGNED, SEALED AND DELIVERED

(Signature)

(Name and designation of Authority's Representative)

(Address)

\*\*\*\*\* End of the Document \*\*\*\*\*